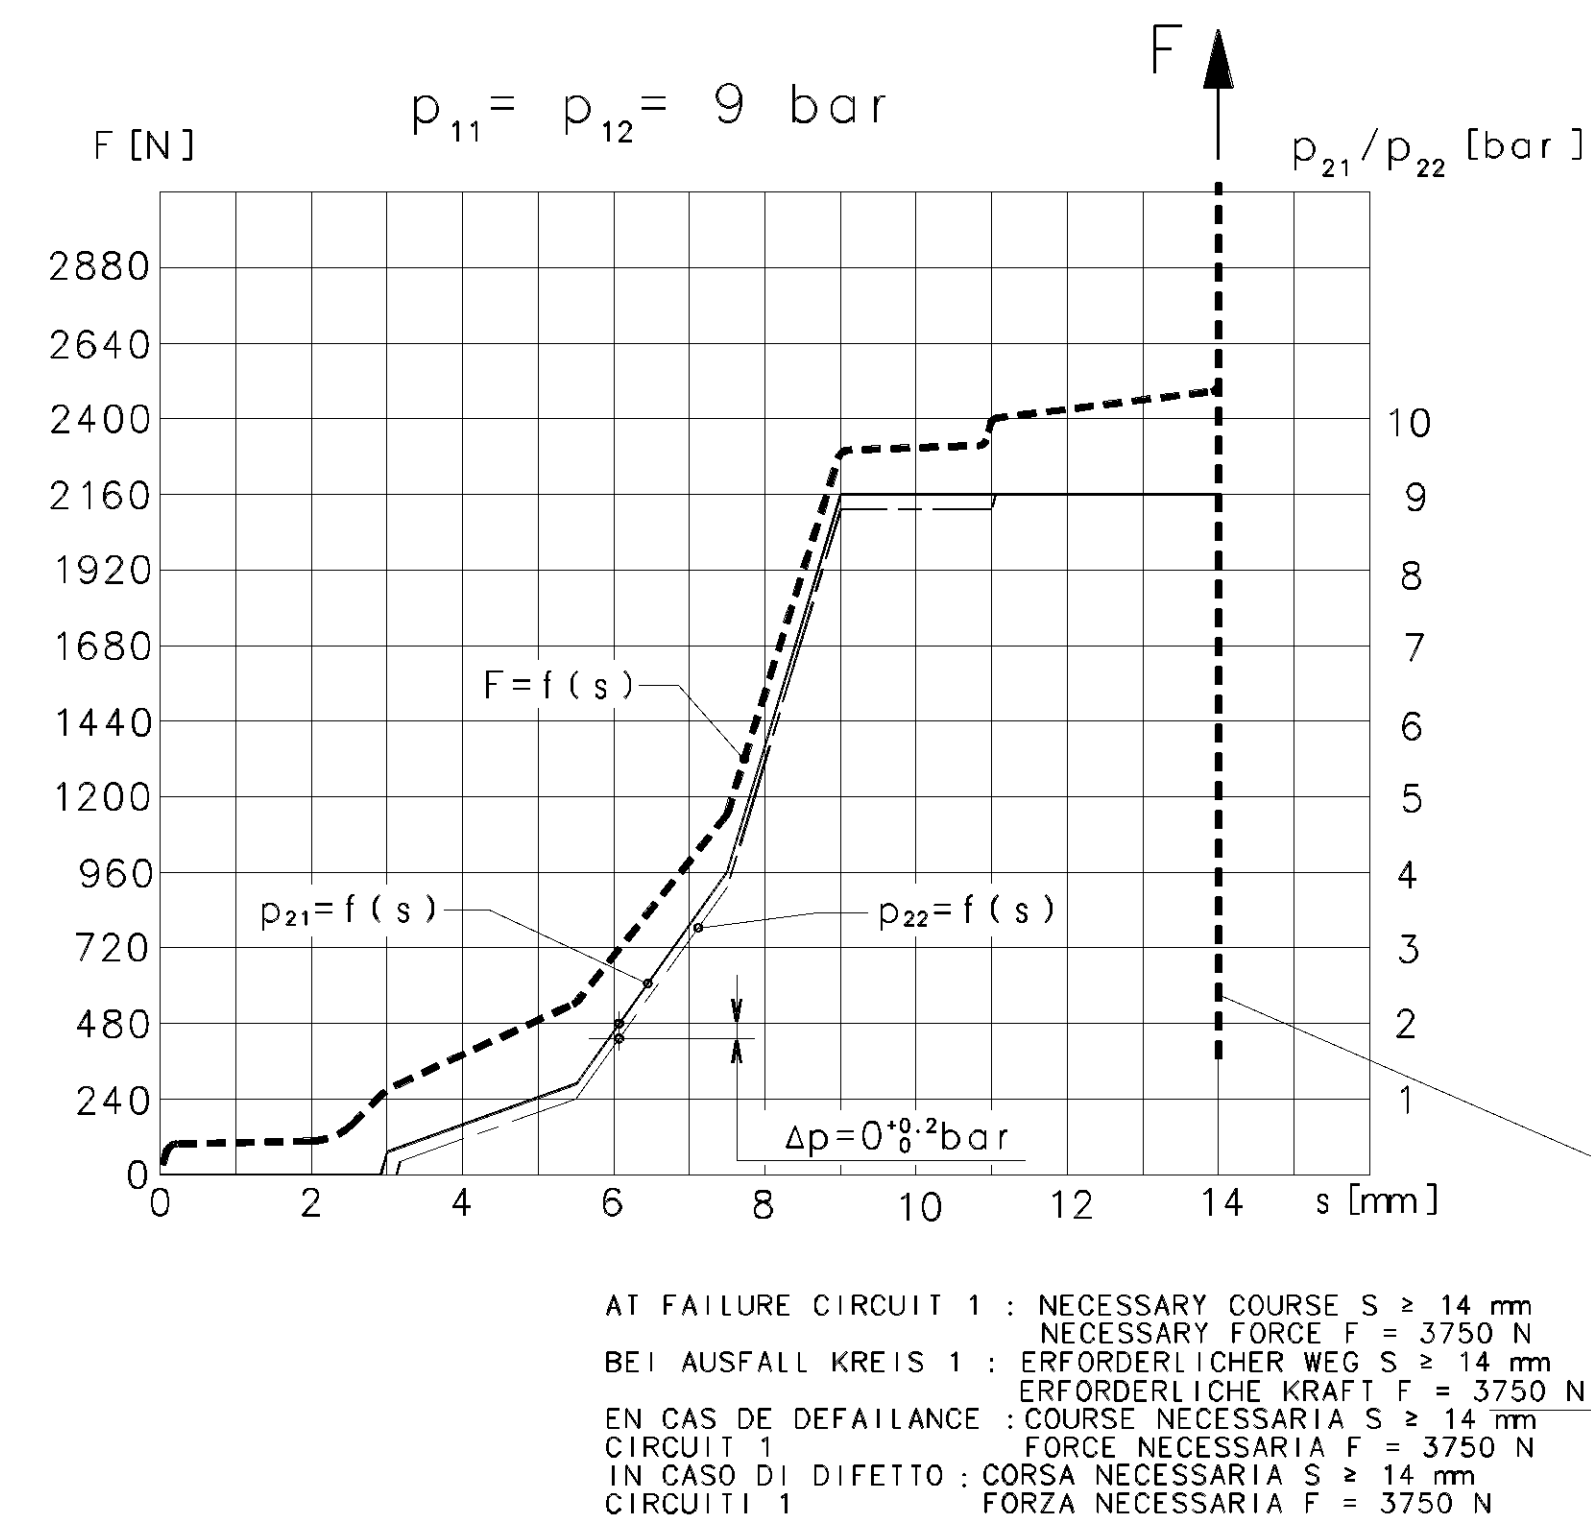
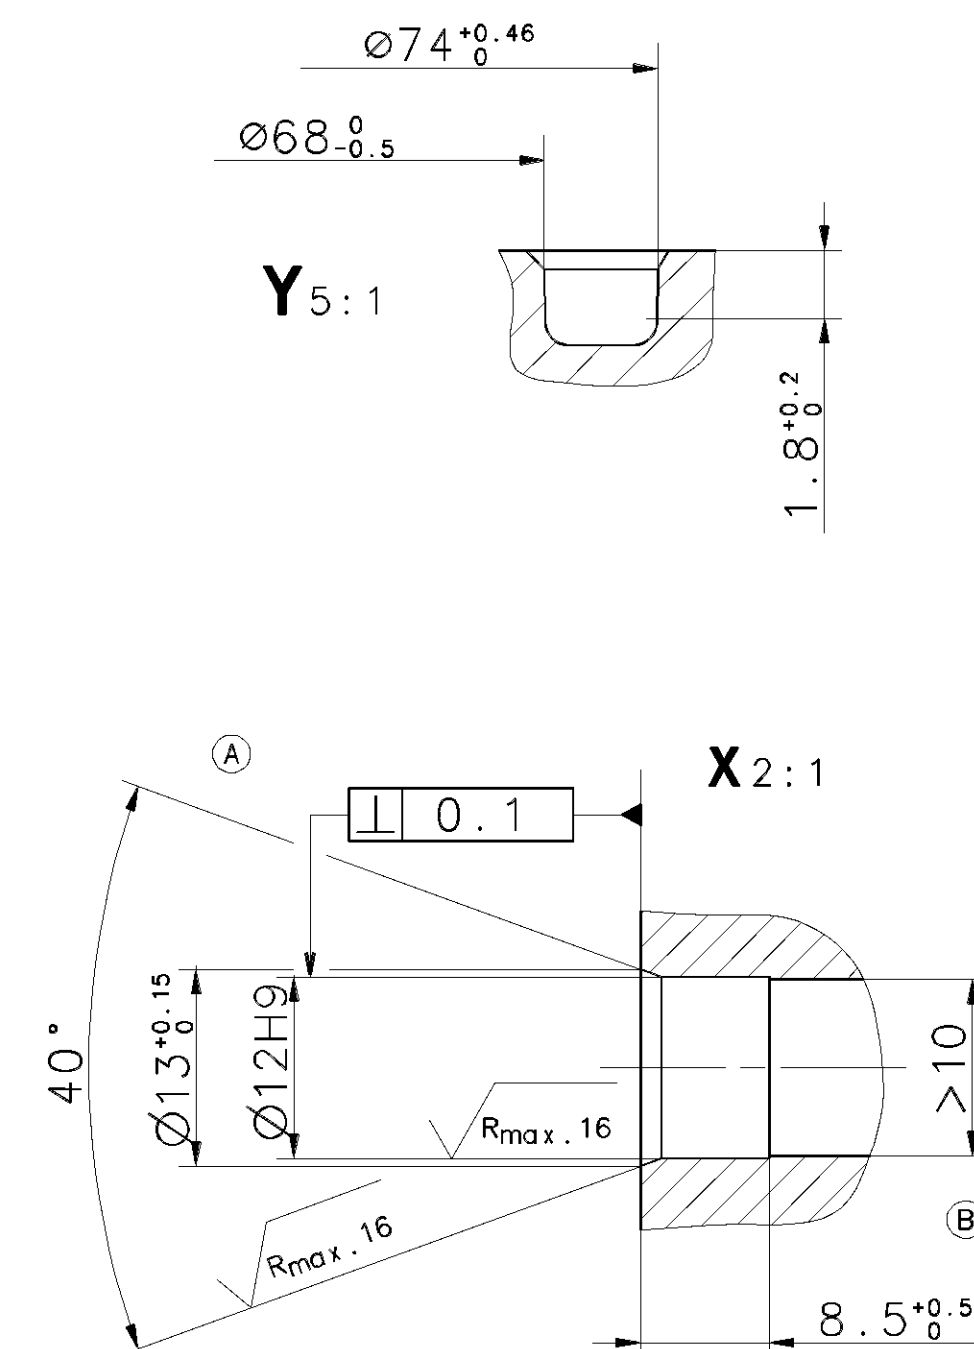
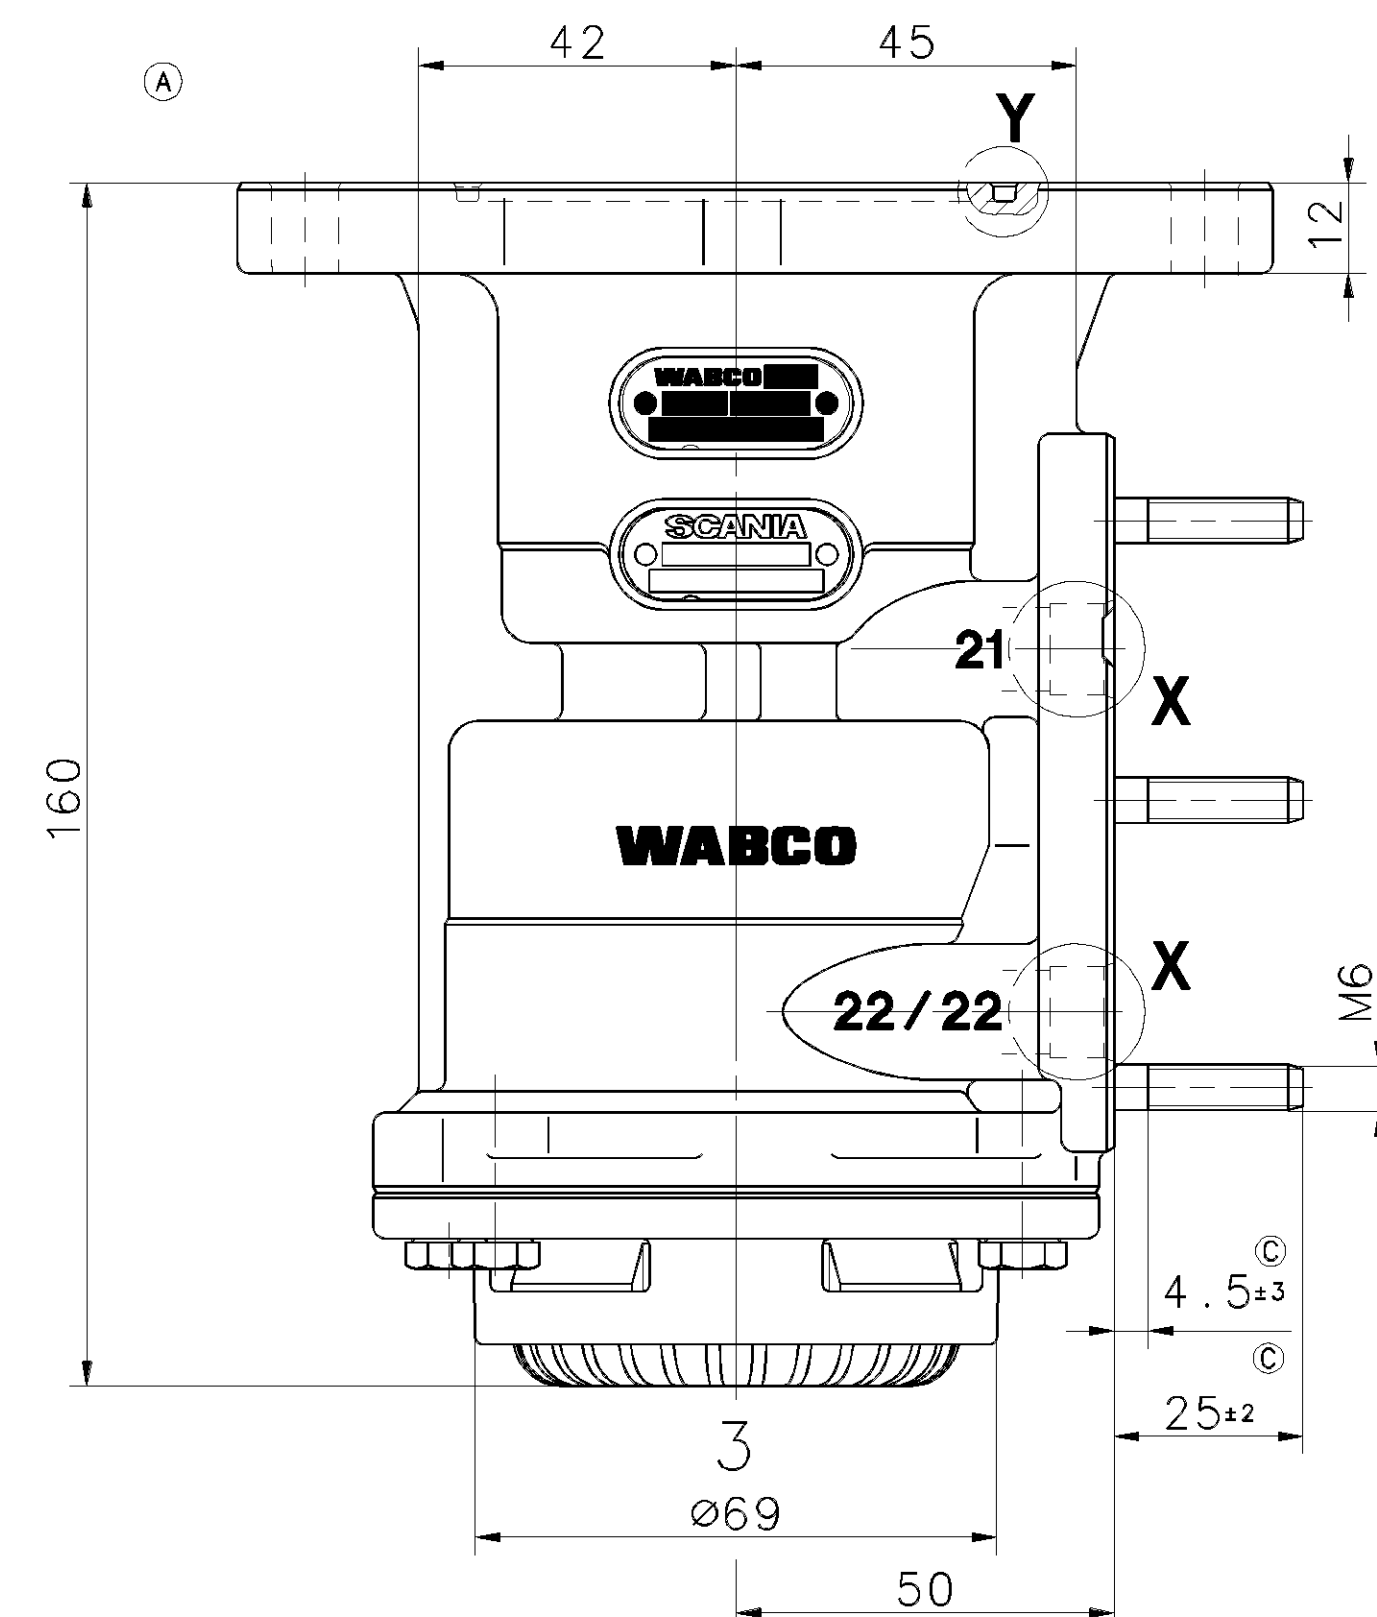
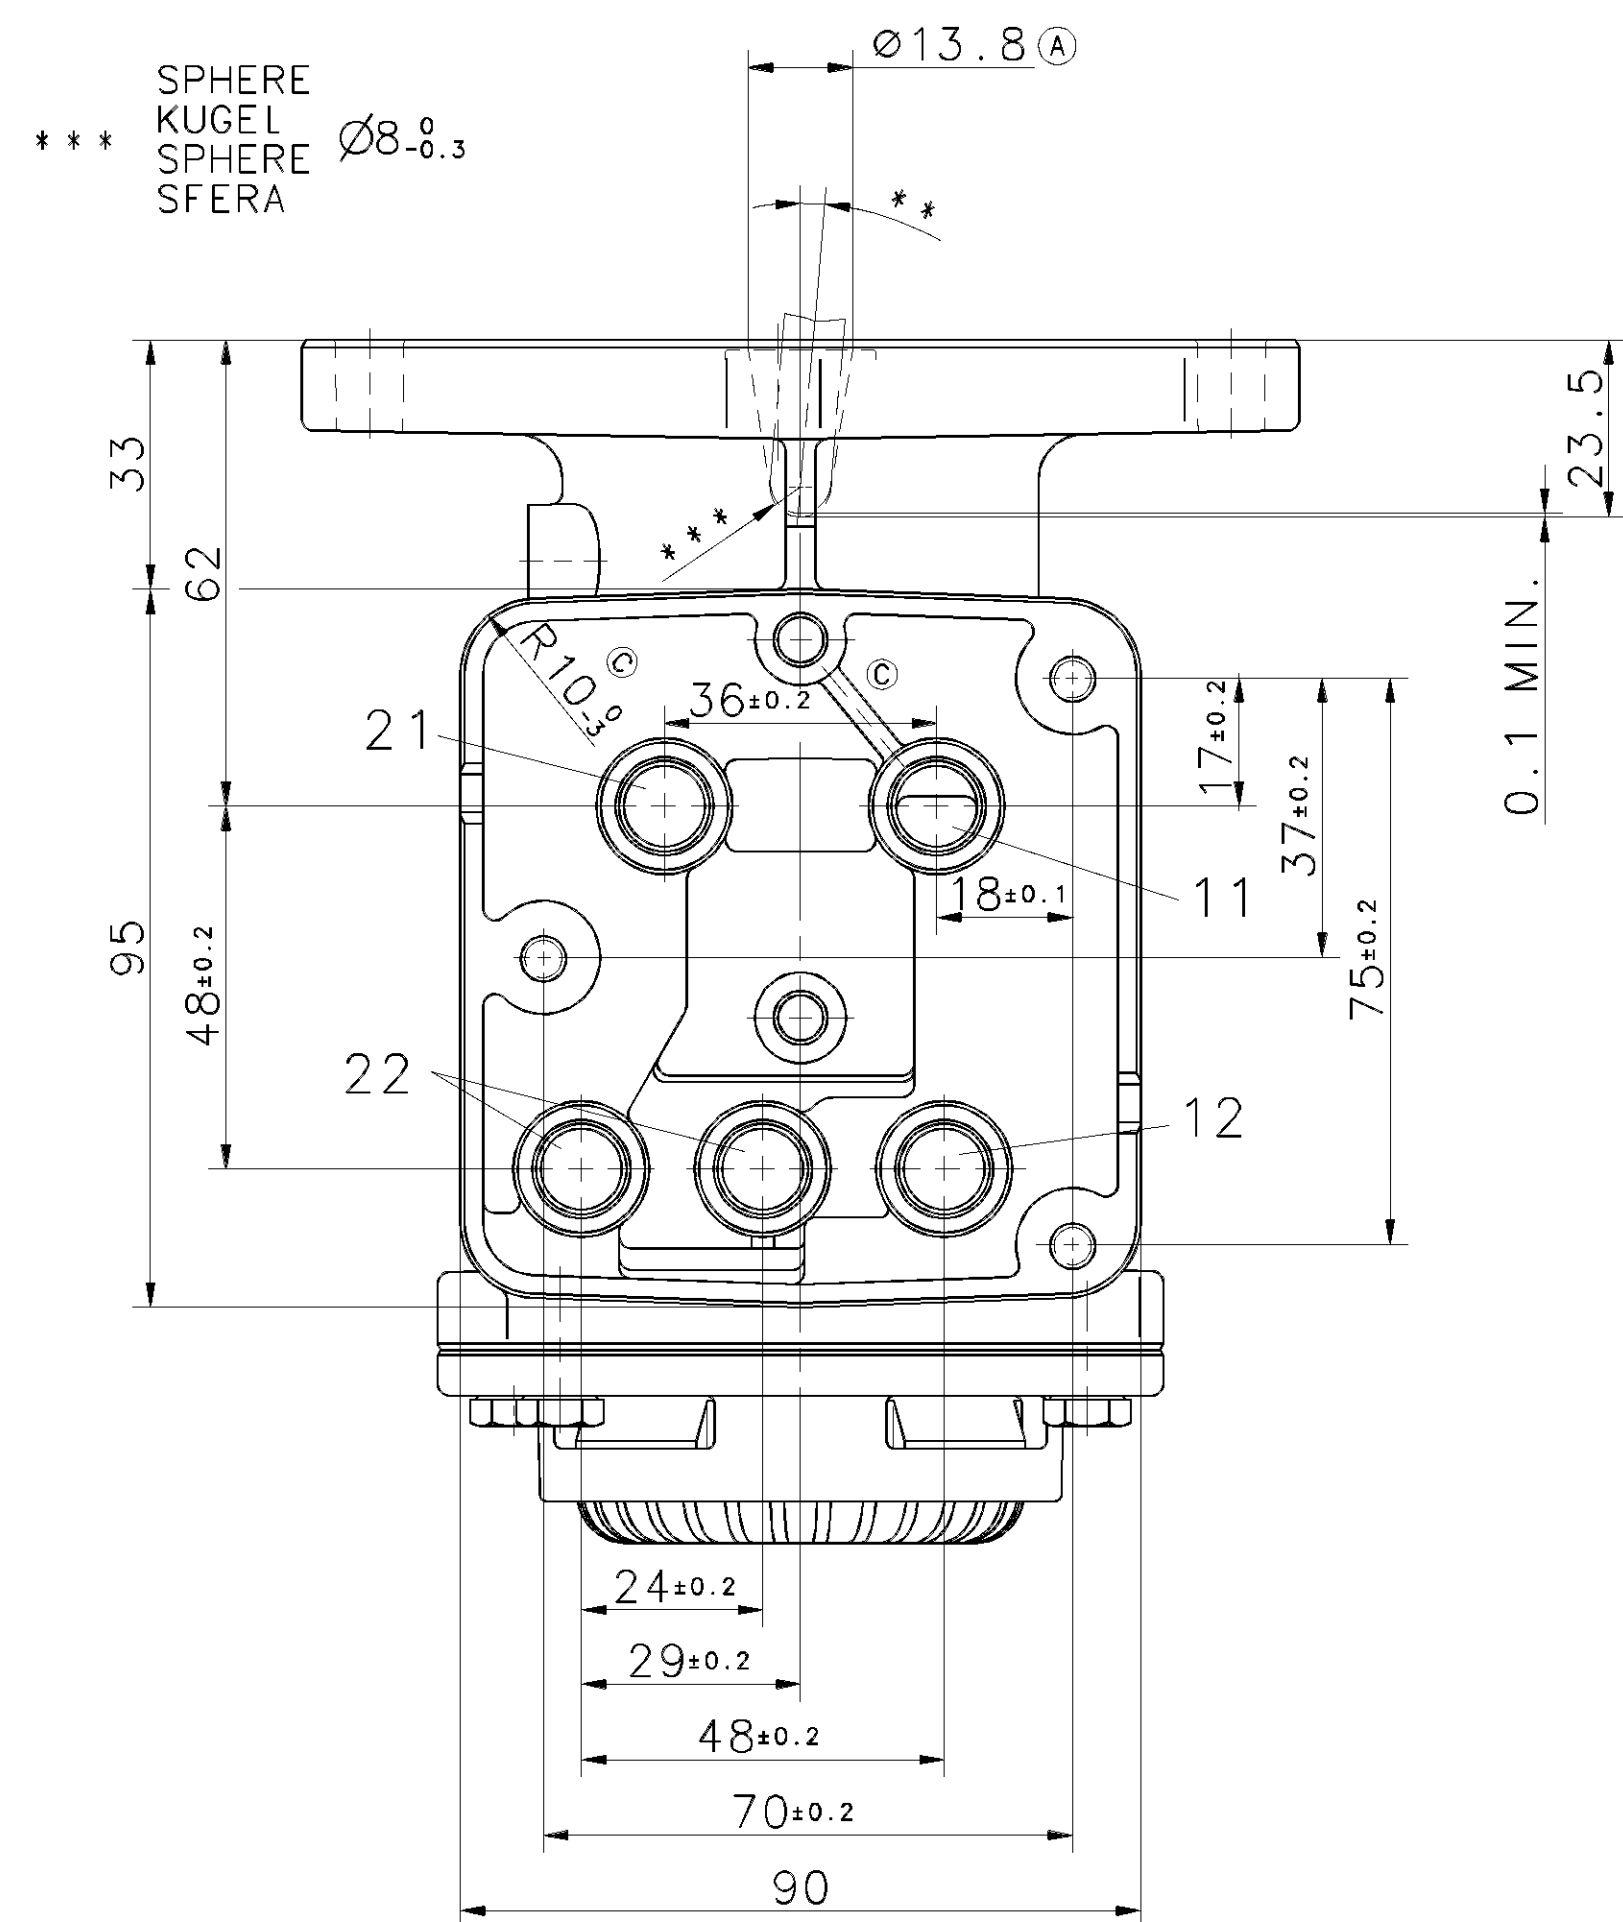


[illegible]

STOP WITHIN THE DEVICE ADMISSIBLE
* ANSCHLAG IM GERAET ZULAESSIG
BUTEE DANS L APPARAIL ADMISE
ARRESTO NEL APPARATO AMMISSIBILE


11/12	SUPPLY VORRAT ALIMENTATION ALIMENTAZIONE	21/22	OUTLET AUSGANG SORTIE USCITA	3	EXHAUST ENTLUEFTUNG ECHAPPEMENT SCARICO
-------	---	-------	---------------------------------------	---	--

MEDIUM: AIR NOMINAL DIAMETER:
MEDIUM: LUFT NENNWEITE:
FLUIDE: AIR DIAMETRE NOMINAL: 78.5mm± 0.10mm
FLUIDO: ARIA DIAMETRO NOMINALE:

WORKING PRESSURE: (TEMPORARILY:
BETRIEBSDRUCK: (KURZZEITIG: $p_e = \text{MAX. } 9 \text{ bar}$ $p_e = \text{MAX. } 11 \text{ bar}$)
PRESSION D UTILISATION: (DE COURTE DUREE:
PRESSIONE DI ESERCIZIO: (BREVE TEMPO SOLO:

THERMAL RANGE OF APPLICATION:
THERM. ANWENDUNGSBEREICH: -40°C...+80°C
GAMME D APPLICATION THERMIQUE:
CAMPO DI APPLICAZIONE TERMICA:

INSTALLATION POSITION: EXHAUST SHOWN AT BASE (AXIS
CENTRE OF THE DEVICE DEVIATES MAX. 90° FROM VERTICAL) (A)
EINBAUPLATZ: ENTFERTNUNG NACH UNTEREN MITTELACHSE
DES GERÄTES MAX. 90° VON DER SENKRECHTEN ABWEICHEND
POSITION D'INSTALLATION: ÉCHAPPEMENT VERS LE BAS (ÉCART DE L'AXE
MÉDIAN DE L'APPAREIL PAR RAPPORT À LA VERTICALE: 90° MAX.)
POSIZIONE DI MONTAGGIO: SCARICO VERSO IL BASSO (DEVIAZIONE ASSE
APPARECCHIO RISPETTO ALLA VERTICALE: MAX. 90°)

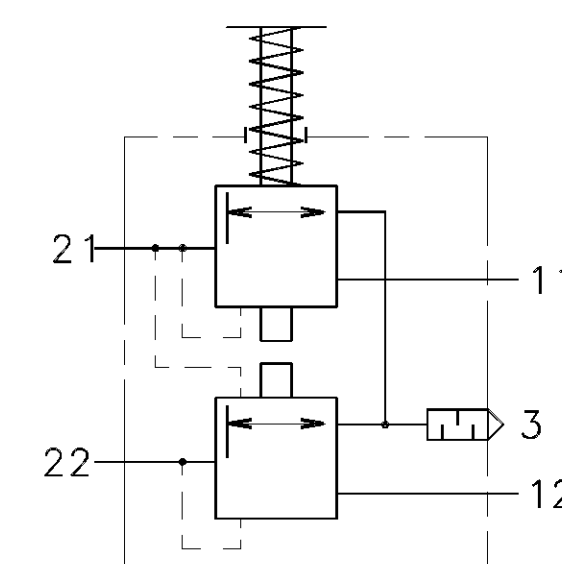[illegible]