

*** MAJOR THREAD DIAMETER
 GEWINDEAUSSENDURCHMESSER 26^{+0.01}_{-0.06}
 DIAMETRE EXTERNEUR
 DIAMETRO ESTERNO

WORKING PRESSURE MAX.
 BETRIEBSDRUCK MAX. 10 bar
 PRESSION D'UTILISATION MAX.
 PRESSIONE DI ESERCIZIO MAX.

ACTUATING FORCE AT RESERVOIR PRESSURE = 5 bar: MAX. 80 N
 BETAETIGUNGSKRAFT BEI VORRATSDRUCK = 7 bar: MAX. 94 N
 EFFORT DE COMMANDE SOUS PRESSION DE RESERVOIR
 FORZA DI COMANDO PRESSIONE DI SERBATOIO

HOLDING FORCE AT RESERVOIR PRESSURE = 5 bar: MAX. 46 N
 HALTEKRAFT BEI VORRATSDRUCK = 7 bar: MAX. 50 N
 EFFORT DE MAINTIEN SOUS PRESSION DE RESERVOIR
 FORZA DI REGIME PRESSIONE DI SERBATOIO

** COURSE = 7.5 ± 0.5
 BETAETIGUNGSWEG
 COURSE
 CORSA


ADMISSIBLE MEDIUM AIR
 ZULAESSIGES MEDIUM LUFT
 FLUIDE ADMISSIBLE AIR
 FLUIDO AMMISSIBILE ARIA

NOMINAL DIAMETER
 NENNWEITE ϕ 4 mm
 DIAMETRE NOMINAL
 DIAMETRO NOMINALE



THERMAL RANGE OF APPLICATION
 THERMISCHER ANWENDUNGSBEREICH - 40 ... + 80 ° C
 GAMME D'APPLICATION THERMIQUE
 CAMPO DI APPLCAZIONE TERMICA

SUPPLY OF ENERGY
 ENERGIEZUFLUSS (VOM VORRAT)
 ALIMENTATION D'ENERGIE
 ALIMENTAZIONE DI ENERGIA

2 } FLOW OF ENERGY
 ENERGIEDURCHFLUSS
 PASSAGE D'ENERGIE
 PASSAGGIO DI ENERGIA

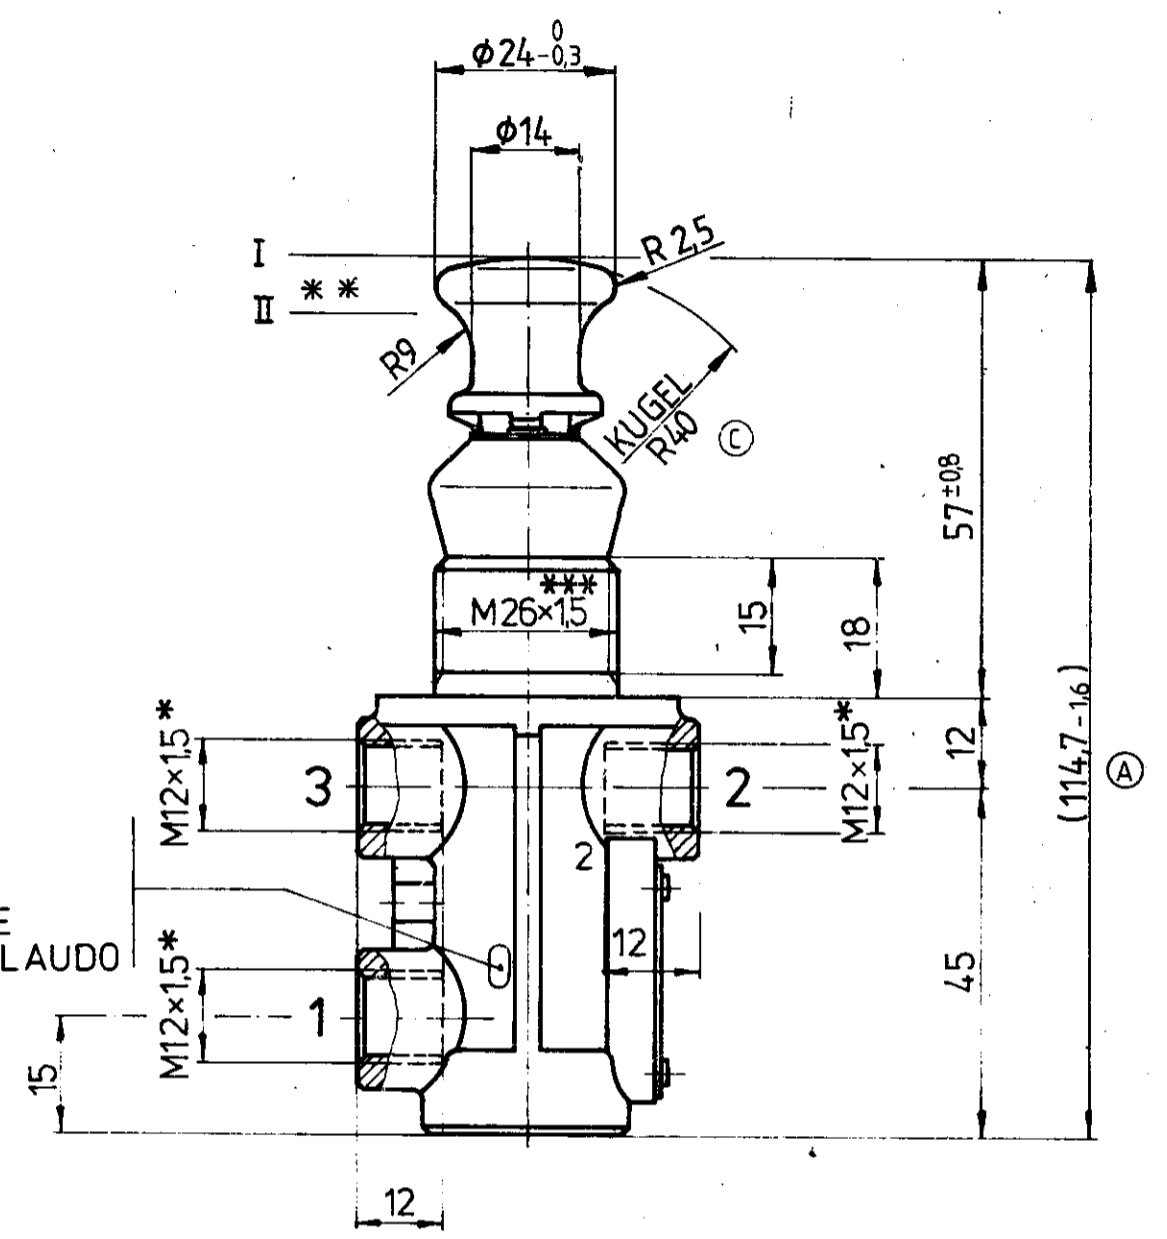

INSPECTION TEST STAMP
 PRUEFSTEMPEL
 MARQUAGE DE CONTROLE
 STAMPIGLIATURA DI COLLAUDO

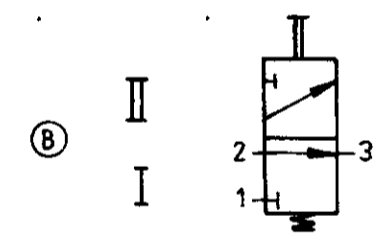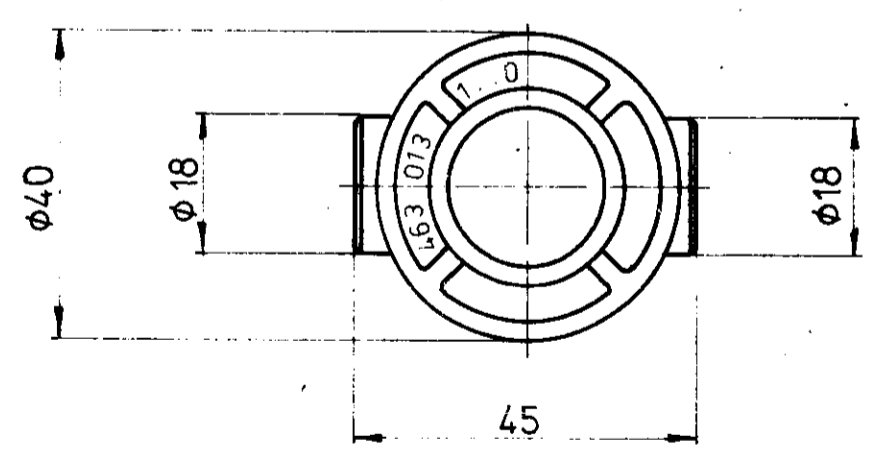

Ⓧ * CORE HOLE DIAMETER ACC. TO JED-152
 KERNLOCHDURCHMESSER NACH JED-152
 DIAMETRE DE TROU NOYAUTE SUIVANT JED-152
 DIAMETRO DEL AVANFORO SECONDO JED-152

WABCO		3/2 DIRECTIONAL CONTROL VAL	
DISTRIBUTEUR 3/2		VALVOLA 3/2	
3/2 WEGE-VENTIL			
29730	1 O 83-12-08	STANDARDIZATION	
22630	2x C 79-07-18		
22049	1x B 79-03-15		
	1x A 78-08-01		
IDENTIFICATION CODE		463 013 126 0	
CODE FOR FUNCTION		CODE FOR SHAPE	
A 2		140	
CODE FOR QUALITY		605	

100 mm