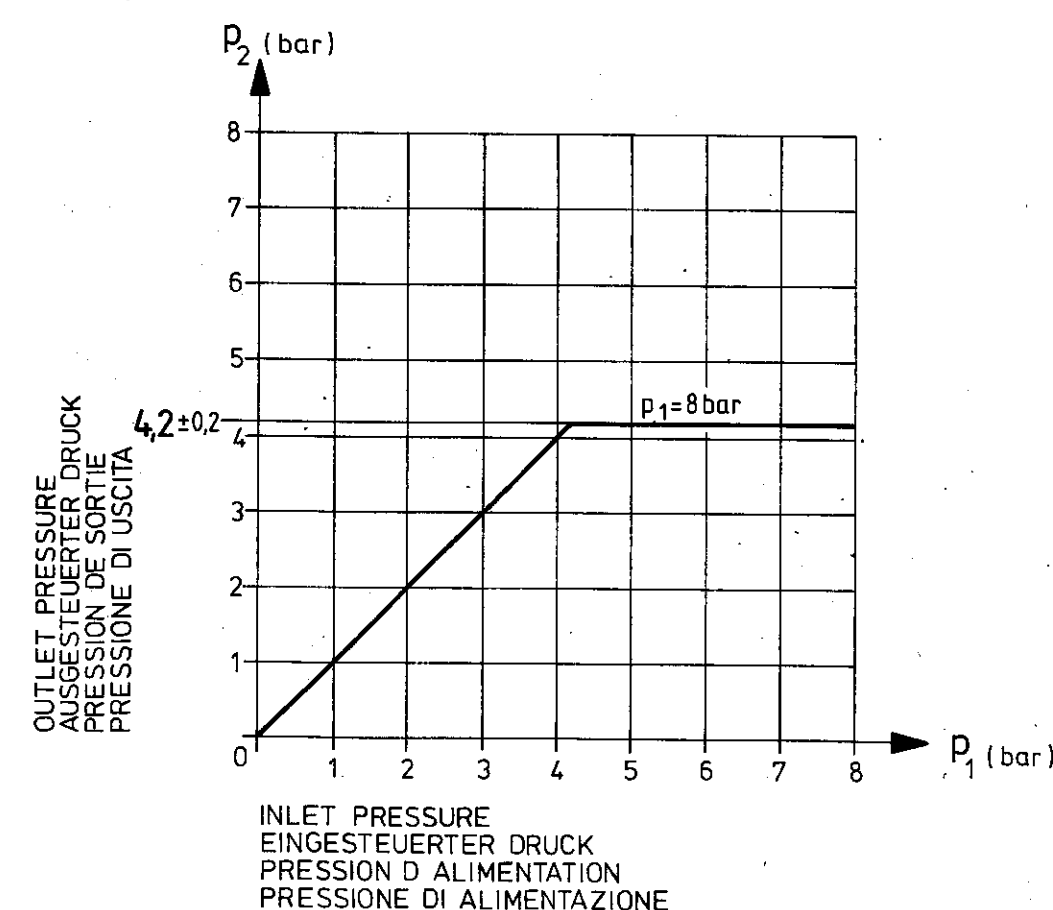
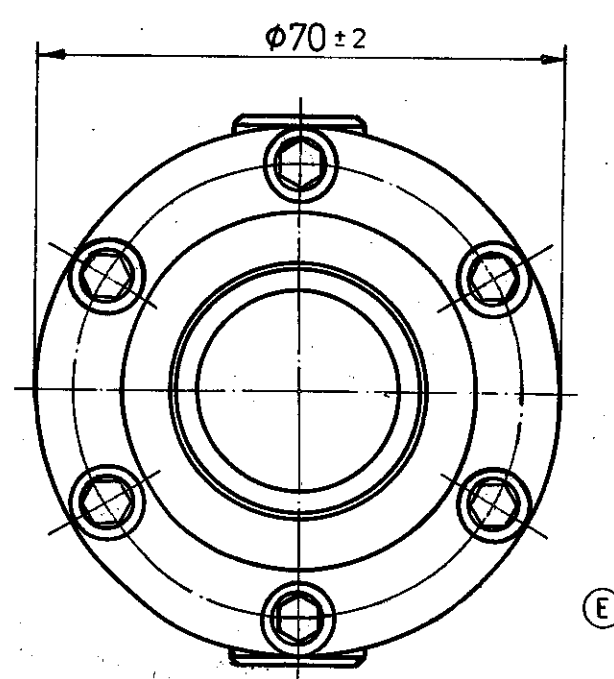
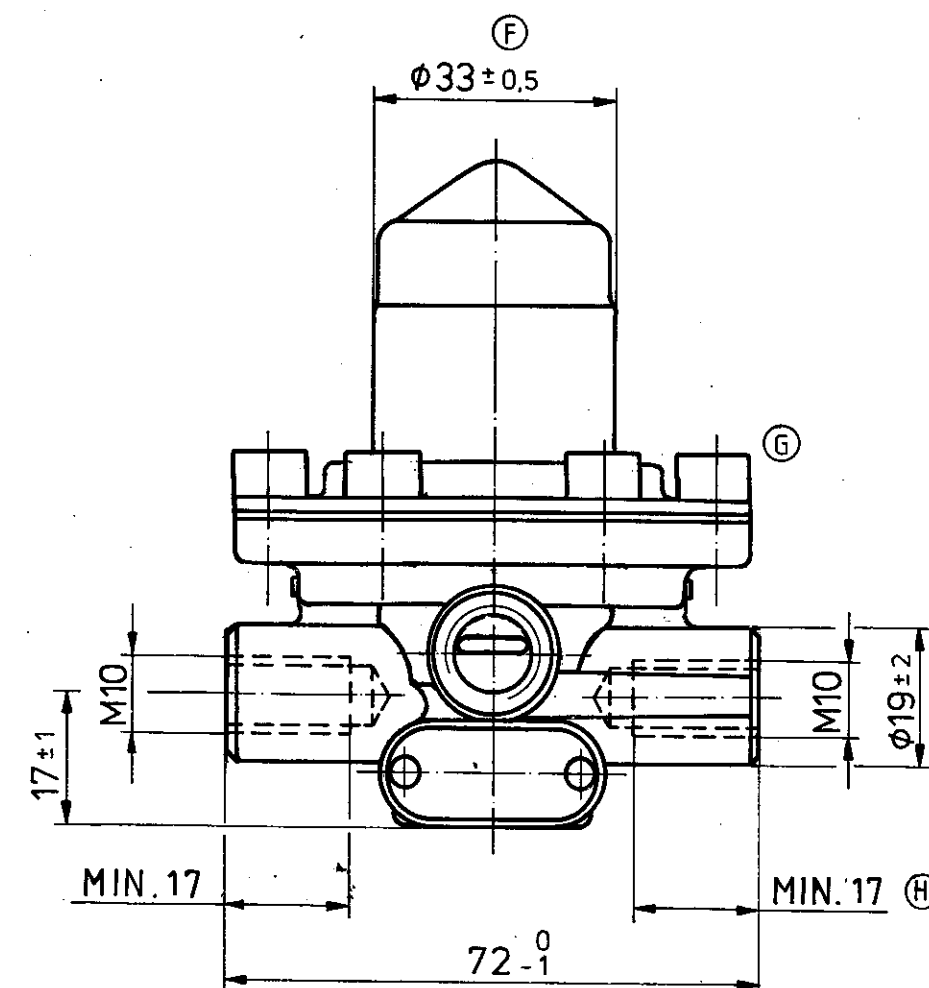
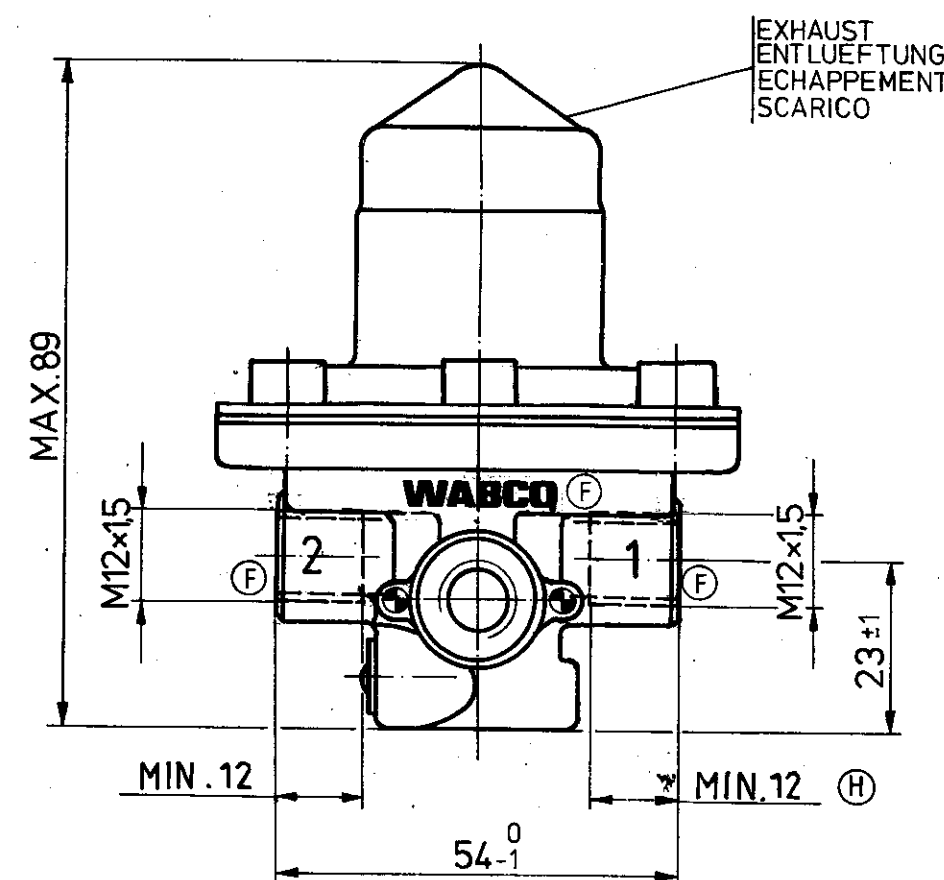


WORKING PRESSURE
BETRIEBSDRUCK
PRESSION D'UTILISATION
PRESSIONE DI ESERCIZIO

MAX.10 bar

GAUGE PRESSURE
UEBERDRUCK
PRESSION MANOMETRIQUE
PRESSIONE MANOMETRICA

MEDIUM
MEDIUM
FLUIDE
FLUIDO

AIR
LUFT
AIR
ARIA

THERMAL RANGE OF APPLICATION
THERMISCHER ANWENDUNGSBEREICH
GAMME D'APPLICATION THERMIQUE
CAMPO DI APPLICAZIONE TERMICA

-40°C +80°C

NOMINAL DIAMETER Ø4
MAX.FREIER DURCHGANG Ø4
DIAMETRE NOMINAL MAX. Ø4
DIAMETRO NOMINALE MAX. Ø4

INSTALLATION POSITION AS DRAWN
EINBAULAGE WIE GEZEICHNET
POSITION D'INSTALLATION SUIVANT DESSIN
POSIZIONE DI MONTAGGIO COME DISEGNATO

INLET PRESSURE
1= EINGESTEUERTER DRUCK
PRESSION D ALIMENTATION
PRESSIONE DI ALIMENTAZIONE

OUTLET PRESSURE
2= AUSGESTEUERTER DRUCK
PRESSION DE SORTIE
PRESSIONE DI USCITA

057010		DATE		SIGNATURE		WABCO WESTINGHOUSE	
335 29	2x (H)	95-01-06	78-04-04	DRAWN	<i>Shu Le</i>	PRESSURE CONTROL VALVE	
31152	4x (F)	85-01-31	78-04-04	CHECKED	<i>Shu Le</i>	REGULATEUR DE PRESSION	
23830	1 (E)	80-02-19	78-04-04	STANDARDIZATION	<i>Shu Le</i>	REGOLATORE DI PRESSIONE	
11877	(D)	78-04-04	78-04-06			DRUCKMINDERVENTIL	
CHANGE NO		LETT	DATE	MASS	SCALE	IDENTIFICATION CODE	
20		(A)		13	1:1	475 009 002 0	
REPLACEMENT FOR		SIZE	TR 1	140		CODE FOR FUNCTION	
ORIG. 475 009 000 0		A 2				CODE FOR SHAPE	
OF 69-06-26						CODE FOR DOCUMENT	
						605	