

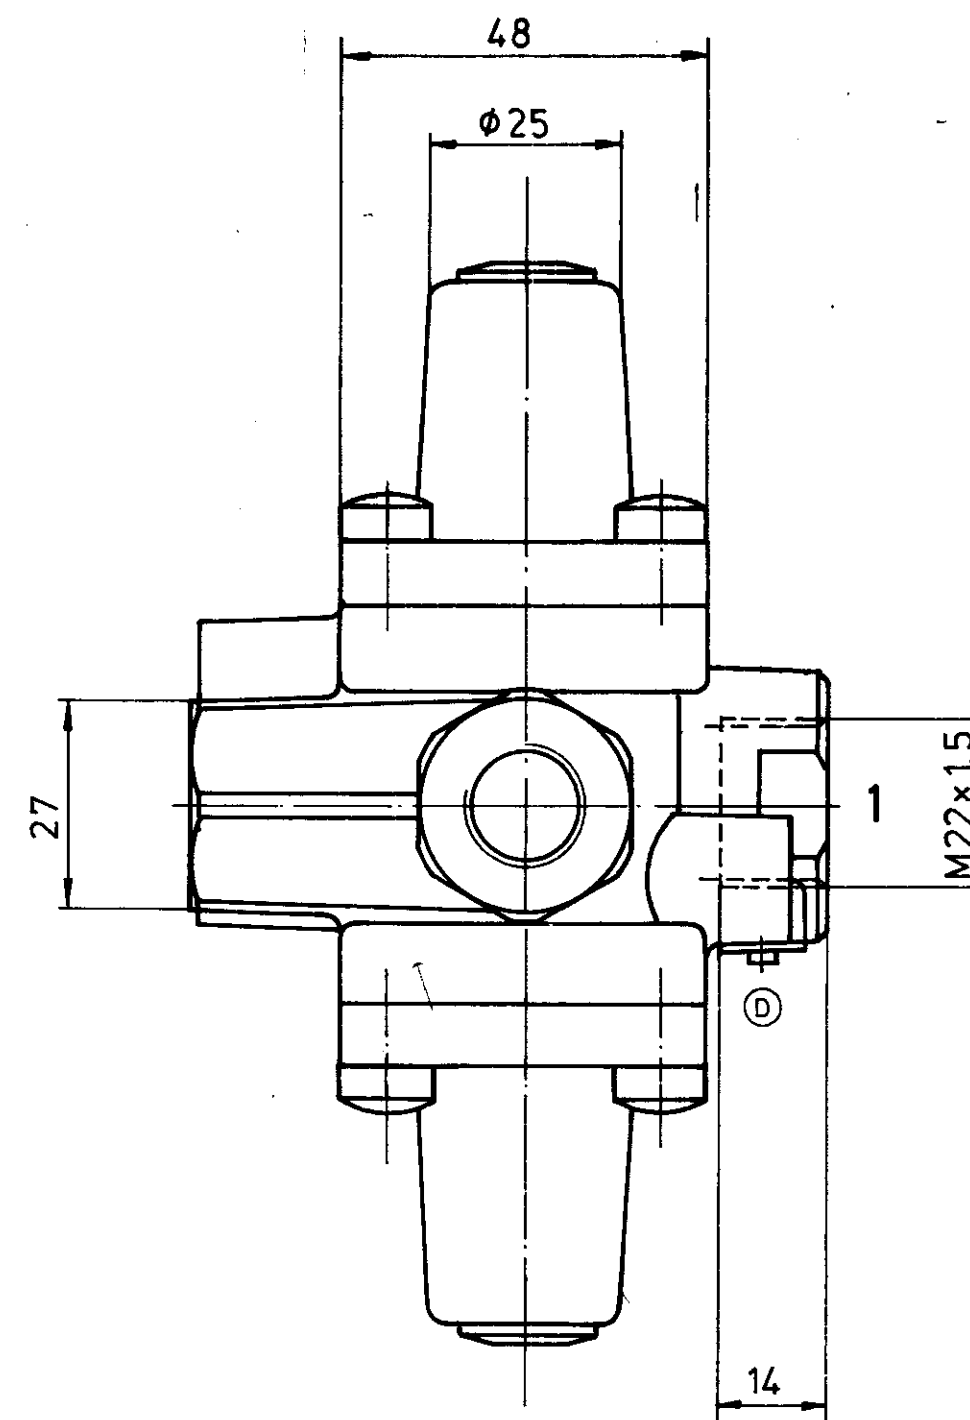
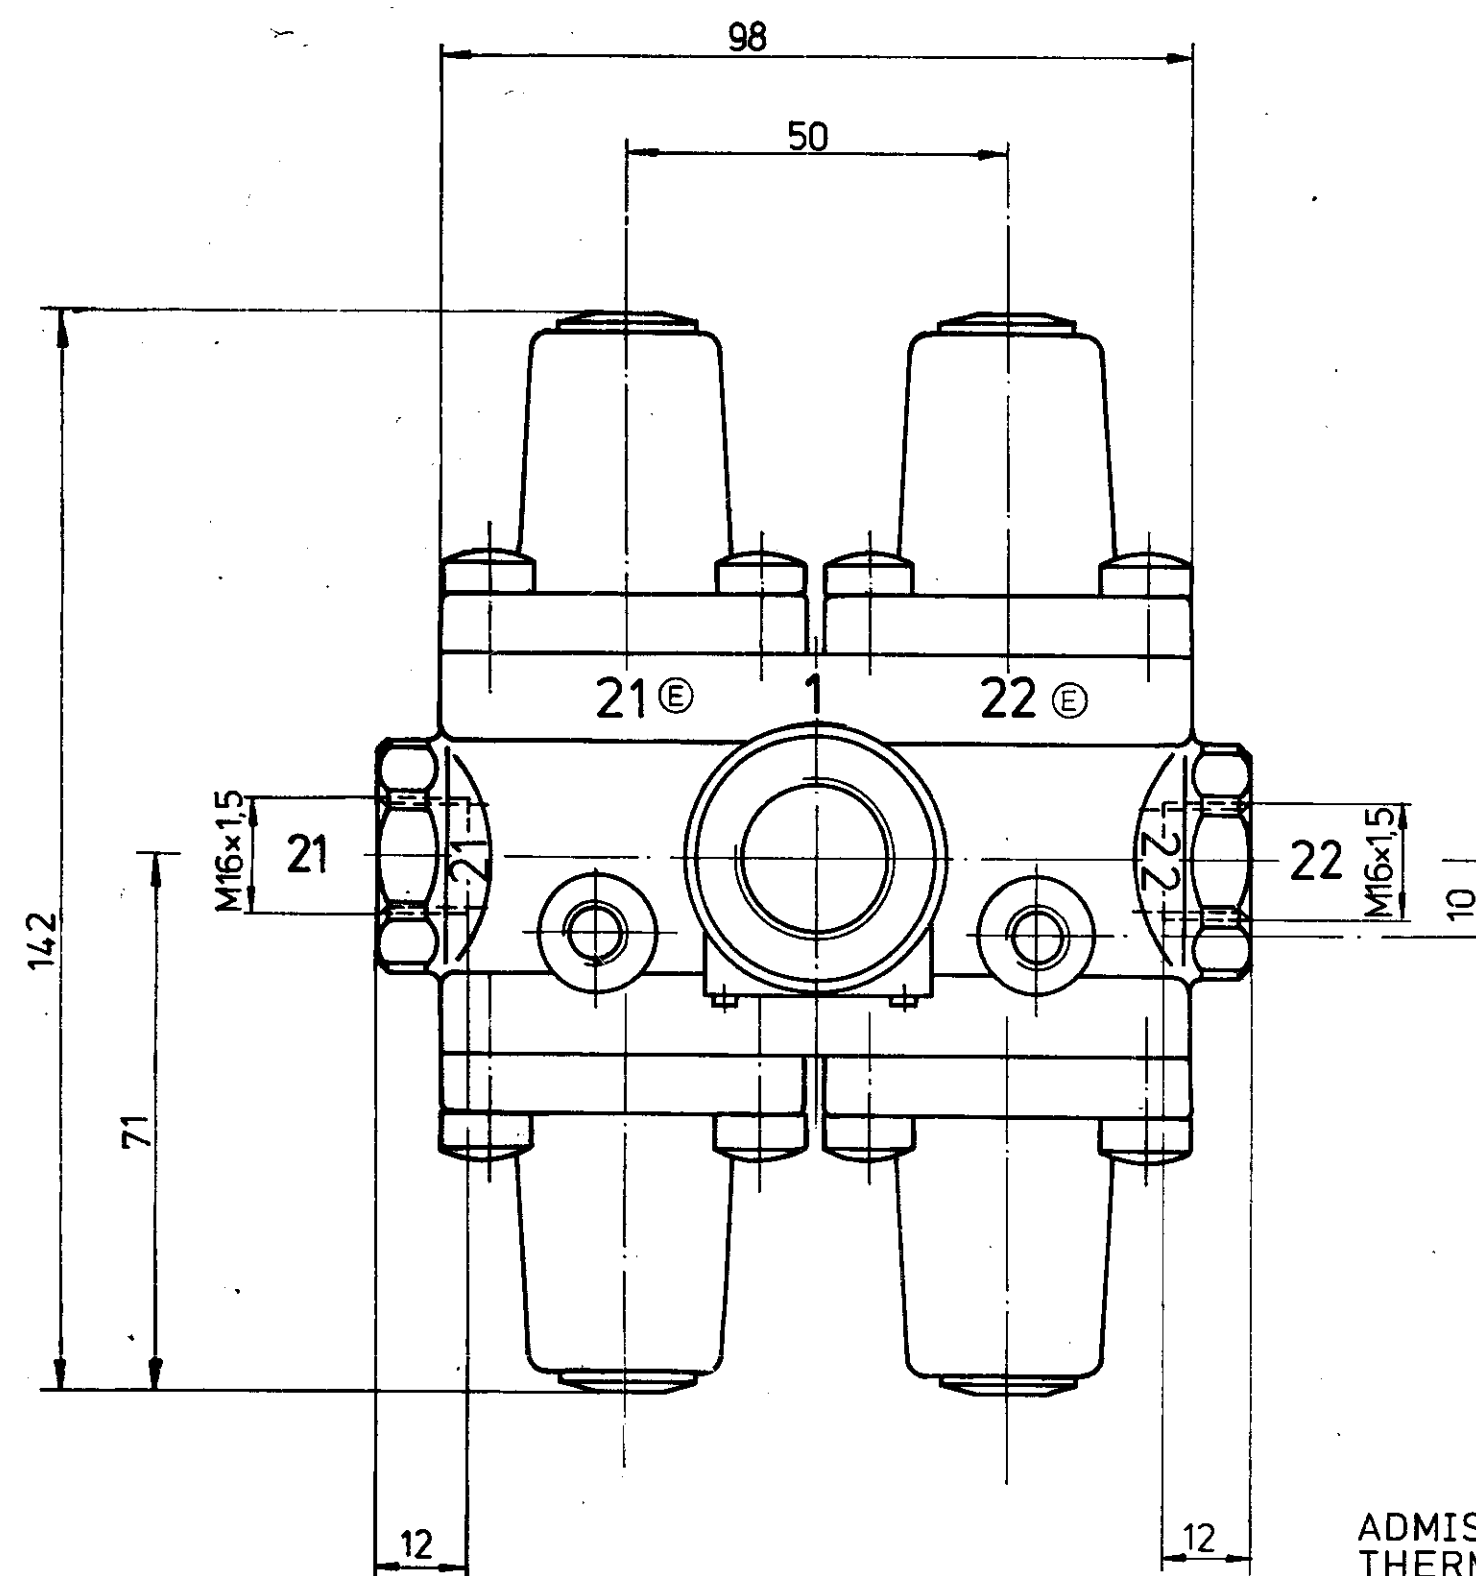


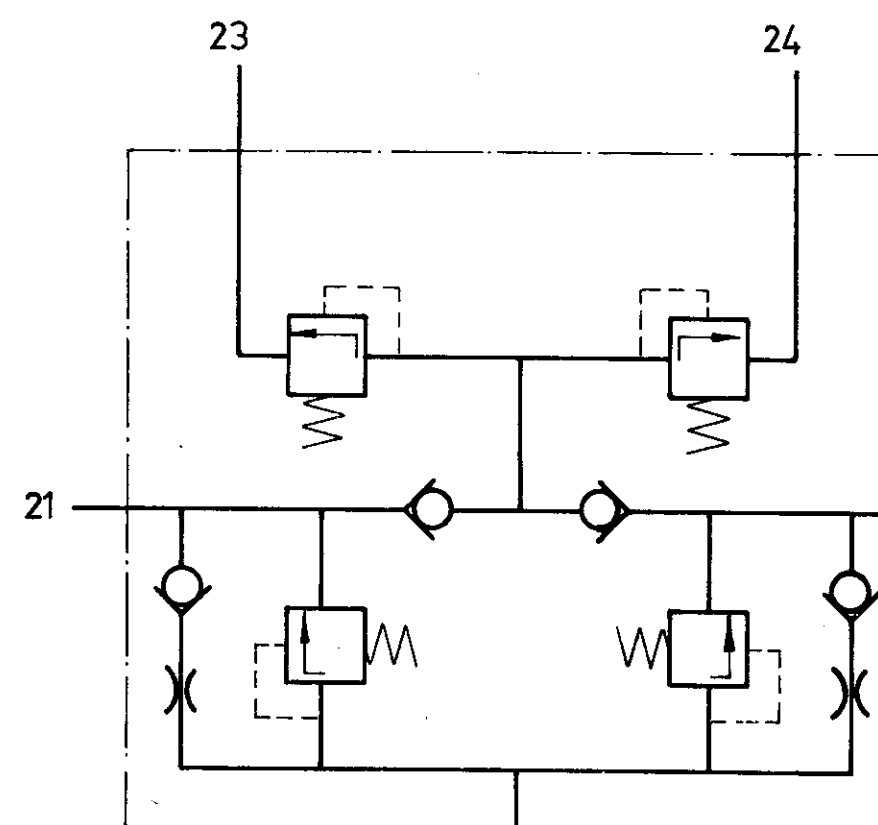

ADMISSIBLE TEMPERATURES
THERMISCHER ANWENDUNGSBEREICH -40°C...+90°C
TEMPERATURE DE SERVICE
TEMPERATURA D'ESERCIZIO

* OPENING PRESSURE = MAINTAINED PRESSURE
OEFFNUNGSDRUCK = GESICHERTER DRUCK
PRESSION D'OUVERTURE = PRESSION MAINTENUE
PRESSIONE DI APERTURA = PRESSIONE MANTENUTA

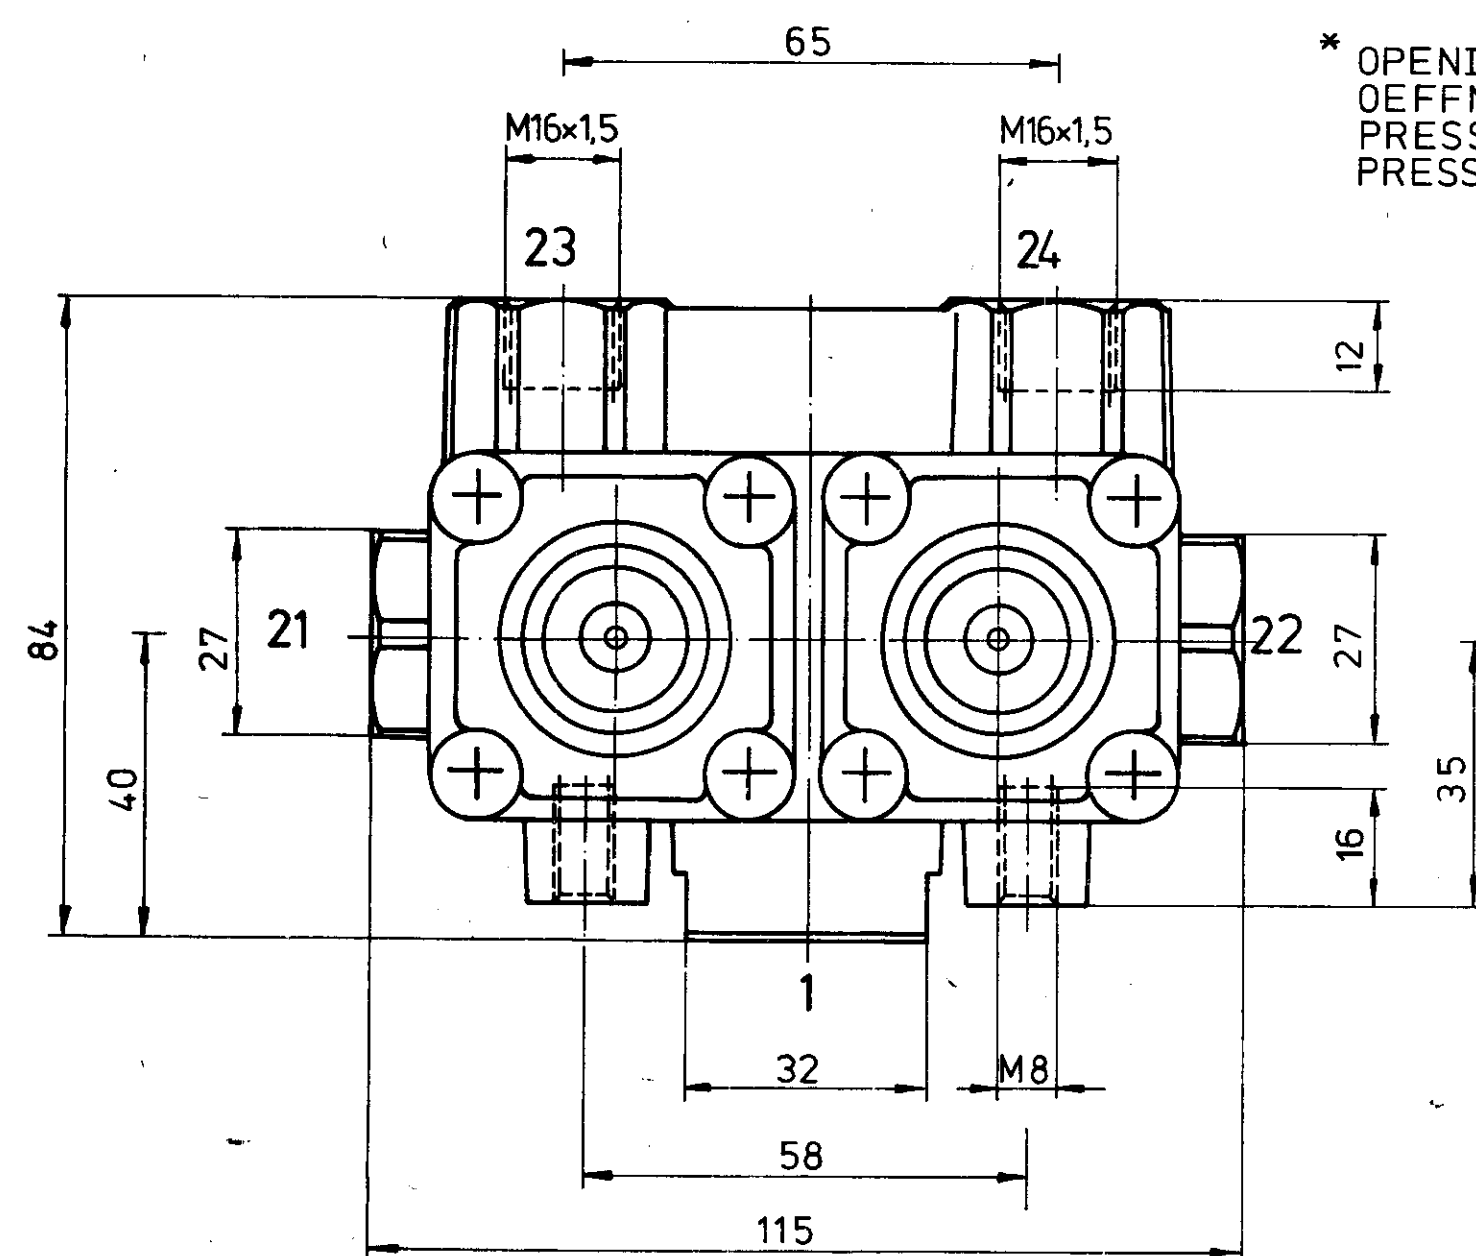

CONNECTIONS: - SUPPLY
ANSCHLUESSE: - LUFTEINTRITT
ORIFICES: 1 - ALIMENTATION
ORIFI: - ALIMENTAZIONE

21 = CIRCUIT 1
= KREIS 1
= CIRCUIT 1
= CIRCUITO 1

22 = CIRCUIT 2
= KREIS 2
= CIRCUIT 2
= CIRCUITO 2

23 = CIRCUIT 3
= KREIS 3
= CIRCUIT 3
= CIRCUITO 3

24 = CIRCUIT 4
= KREIS 4
= CIRCUIT 4
= CIRCUITO 4

MEDIUM: AIR
MEDIUM: LUFT
MILIEU: AIR
FLUIDO: ARIA

WEIGHT: 0,9 kg
GEWICHT:
POIDS:
PESO:

SERVICE PRESSURE: ** (F)
BETRIEBSDRUCK: MAX. 10 bar
PRESSION DE SERVICE: ***
PRESSIONE D'ESERCIZIO: MAX. 20 bar (G)

DEVICE NUMBER GERAETENUMMER NUMERO D'APPAR. CODICE DELLO APP.	CIRCUIT KREIS CIRCUIT CIRCUITO	OPENING PRESSURE * OEFFNUNGSDRUCK PRESSION D'OUVERTURE PRESSIONE DI APERTURA	CLOSING PRESSURE SCHLIESSDRUCK PRESSION DE FERMETURE PRESSIONE DI CHIUSURA
934 702 101 0 ***	1	6,1-0,3 bar	≥ 4,5 bar
	2	6,1-0,3 bar	≥ 4,5 bar
	3	≥ 4,5 bar	3,5-0,3 bar
	4	≥ 4,5 bar	3,5-0,3 bar
934 702 100 0 **	1	7 - 0,3 bar	≥ 5,4 bar
	2	7 - 0,3 bar	≥ 5,4 bar
	3	≥ 6 bar	5 - 0,3 bar
	4	≥ 6 bar	5 - 0,3 bar

Revisions Änderungen Modifications Modifiche	Scale Maßstab Escala Scala	Material Werkstoff Materiale Materiale	Surface protection Oberflächenschutz Protezione Protezione	Treatment Behandlung Trattamento Trattamento	Supplied as Lieferzustand Etat de livraison Stato di consegna
38199 G 261088	1:1				
38132 F 24388					
14679 E 161276					
896 D 91274					
161 C 231173					
C.N. No. Letter Date					
Drawn 2.11.73					
Checked					
Approved					
PROTECTION VALVE (FOR 4 CIRCUITS) SCHUTZVENTIL (FÜR 4-KREIS-ANLAGE) VALVE DE PROTECTION (A 4 CIRC.) VALVOLA DI PROTEZIONE (A 4 CIRC.)					A 934 702 100 0
WESTINGHOUSE JOINT ENGINEERING DEPARTMENT					Regulation for Erre für Règlement Regolamento