

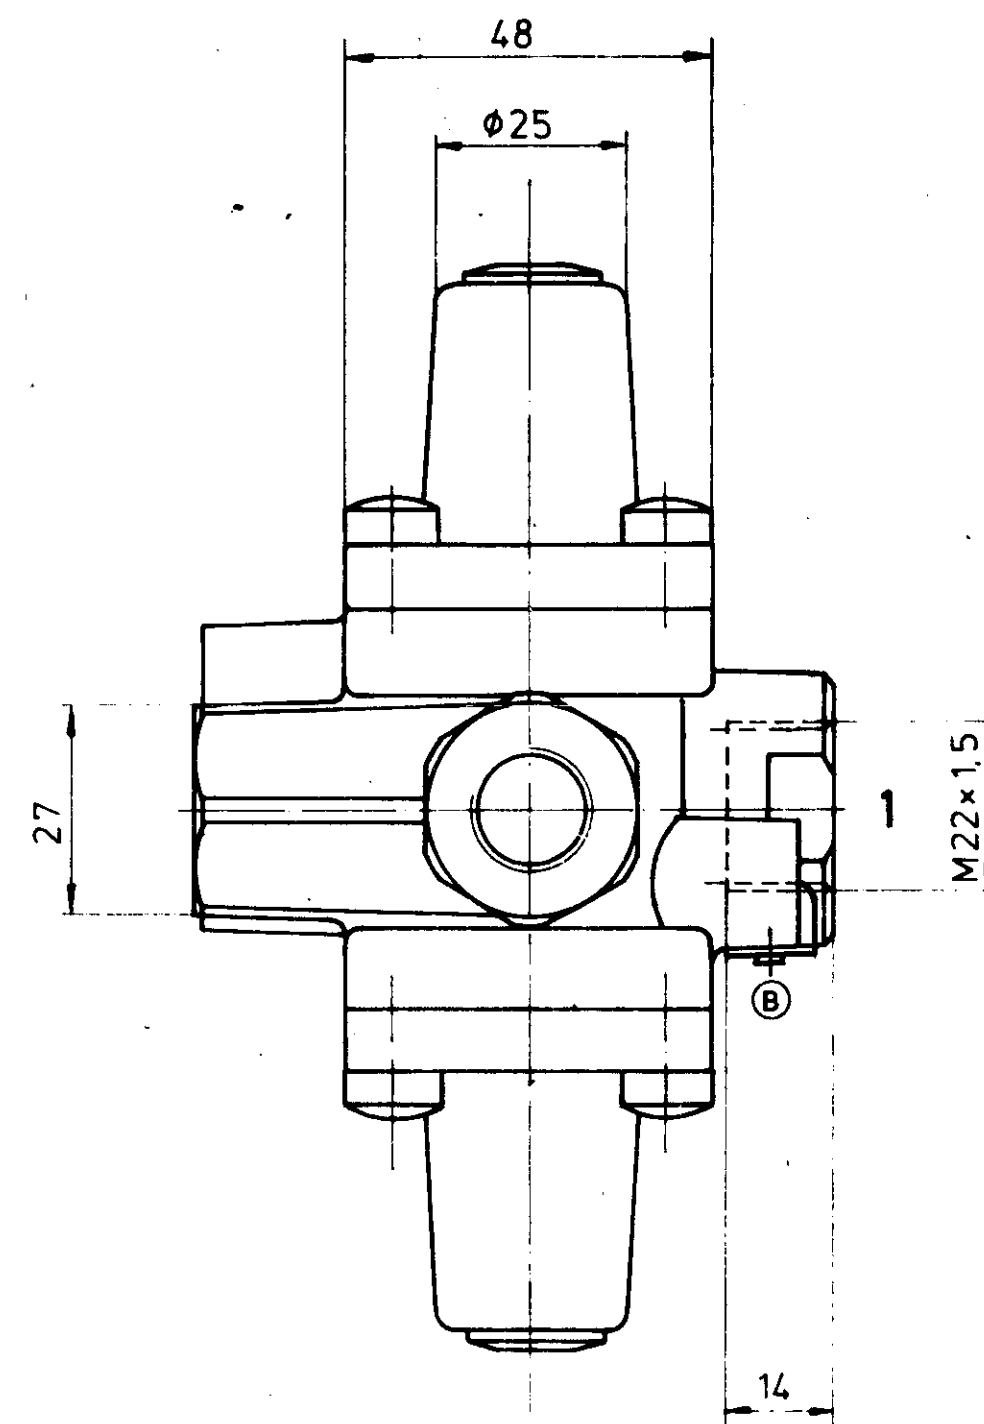
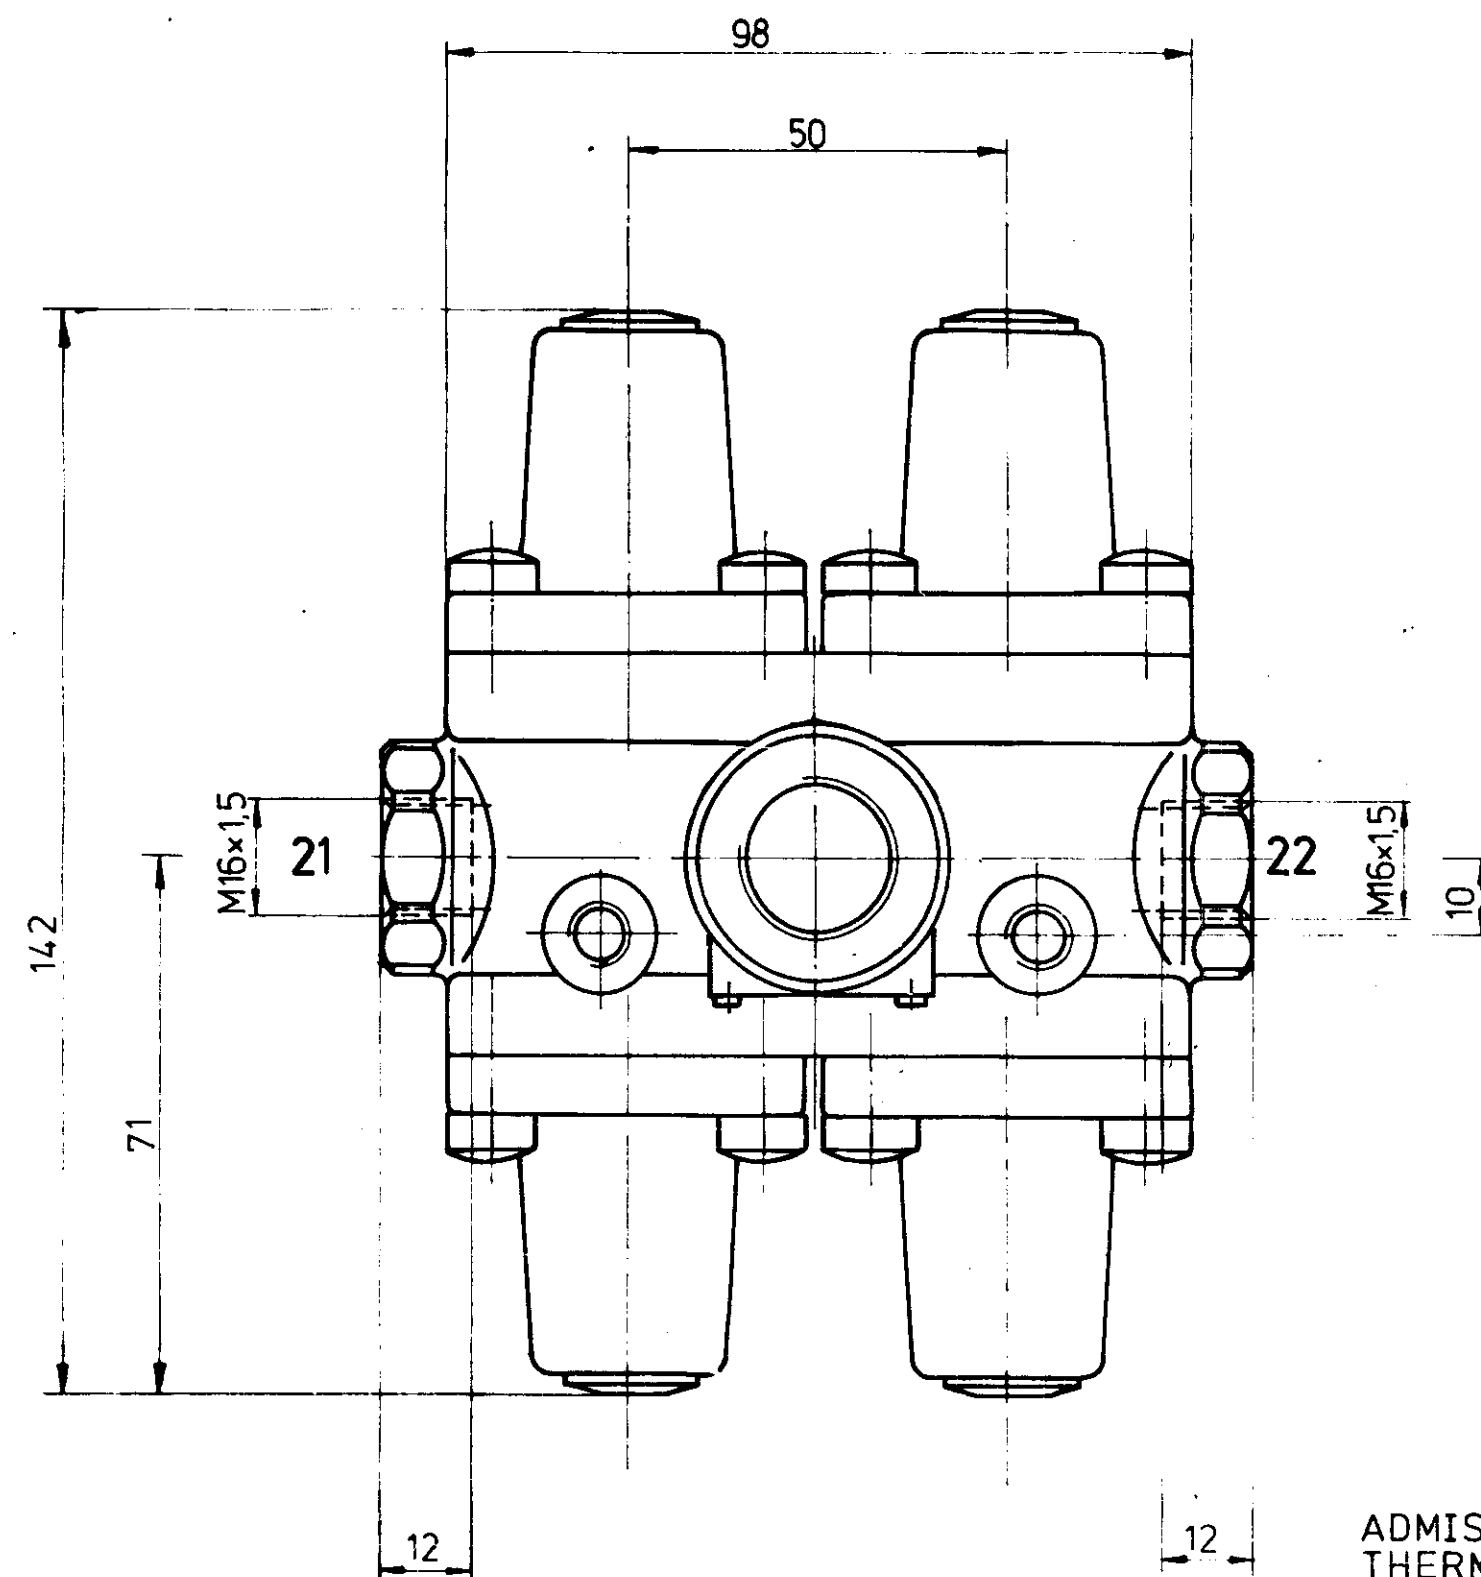


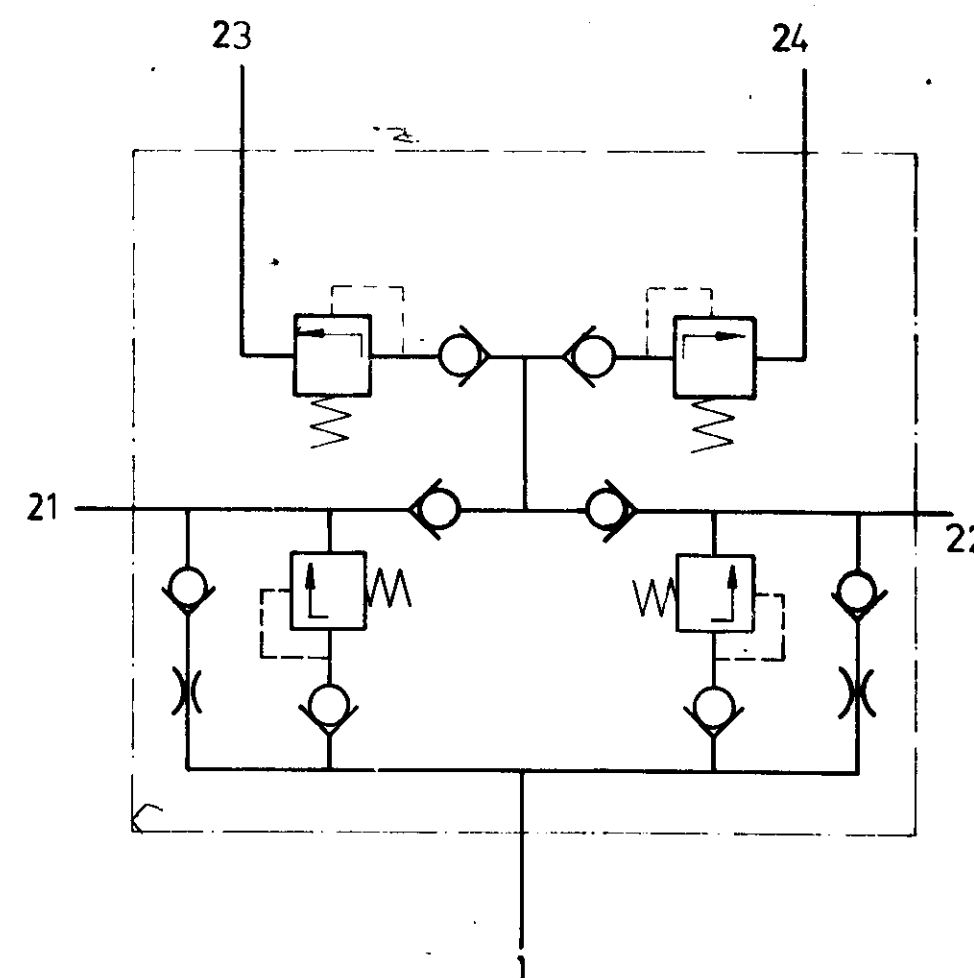

ADMISSIBLE TEMPERATURES
THERMISCHER ANWENDUNGSBEREICH -40°C...+90°C
TEMPERATURE DE SERVICE
TEMPERATURA D'ESERCIZIO

* OPENING PRESSURE = MAINTAINED PRESSURE
OEFFNUNGSDRUCK = GESICHERTER DRUCK
PRESSION D'OUVERTURE = PRESSION MAINTENUE
PRESSIONE DI APERTURA = PRESSIONE MANTENUTA

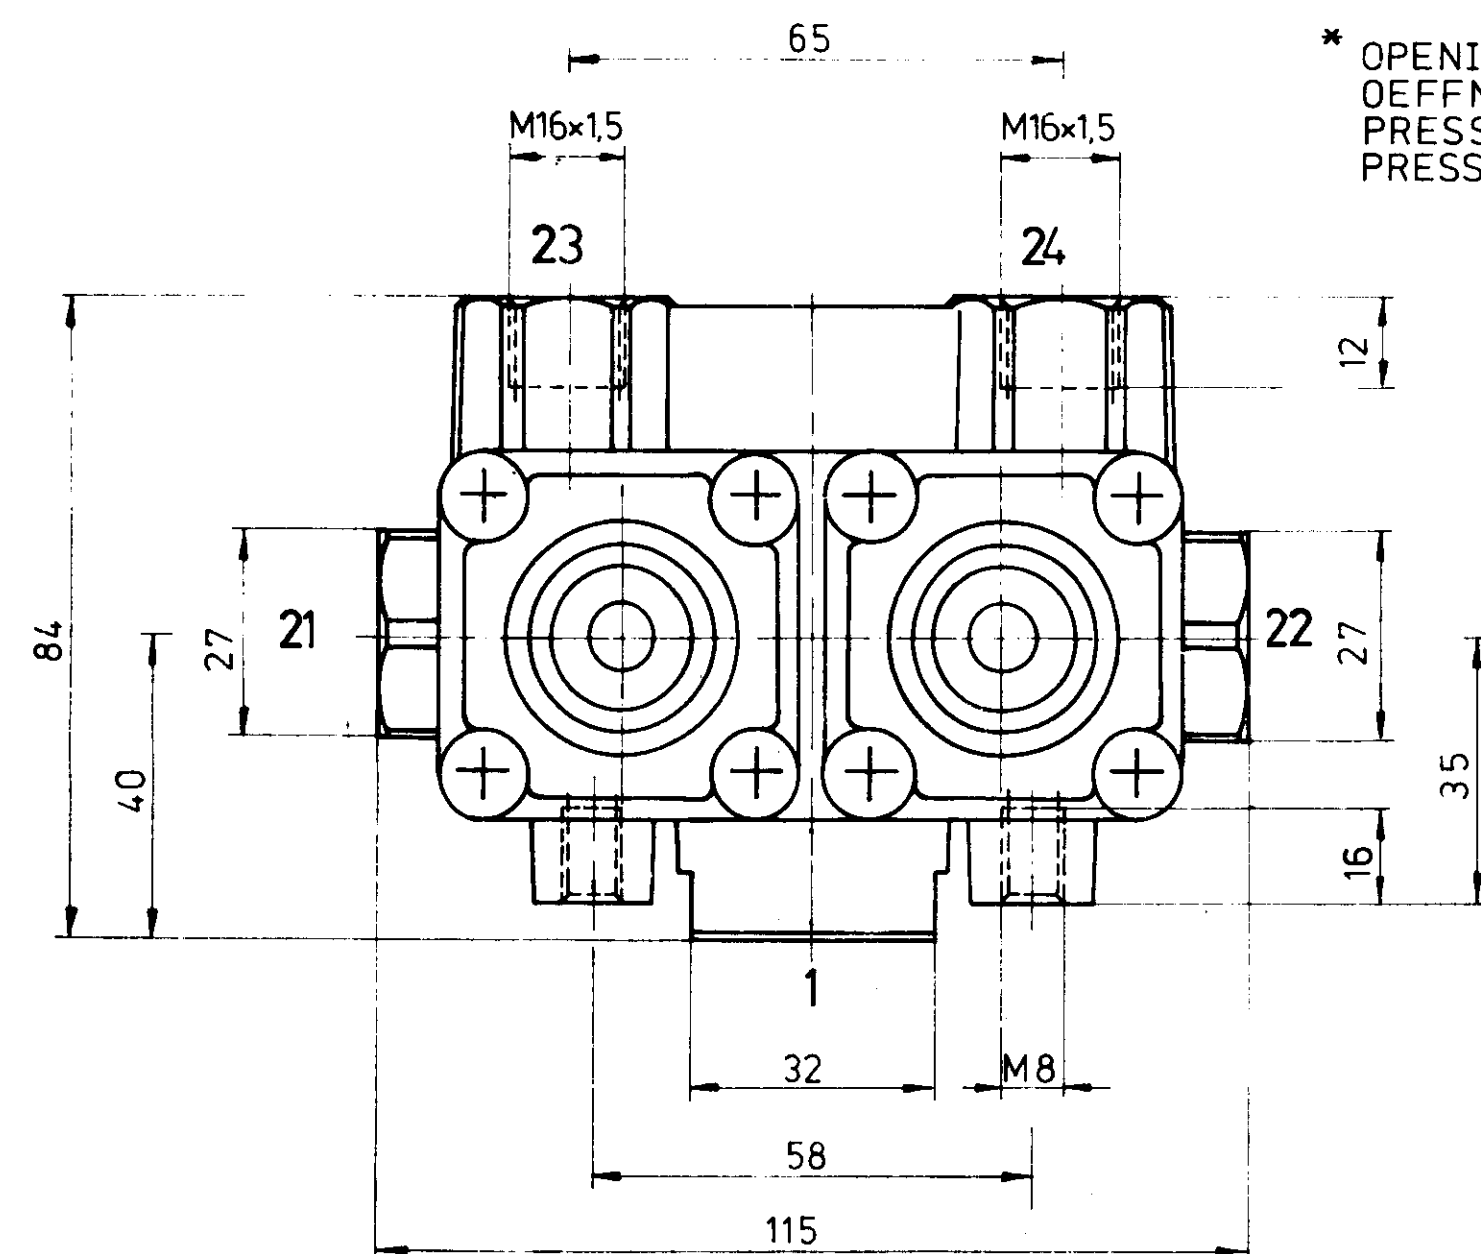

CONNECTIONS: - SUPPLY
ANSCHLUESSE: 1 - LUFTEINTRITT
ORIFICES: - ALIMENTATION
ORIFIZI: - ALIMENTAZIONE

21 = CIRCUIT 1
= KREIS 1
= CIRCUIT 1
= CIRCUITO 1

22 = CIRCUIT 2
= KREIS 2
= CIRCUIT 2
= CIRCUITO 2

23 = CIRCUIT 3
= KREIS 3
= CIRCUIT 3
= CIRCUITO 3

24 = CIRCUIT 4
= KREIS 4
= CIRCUIT 4
= CIRCUITO 4

MEDIUM: AIR
MEDIUM: LUFT
MILIEU: AIR
FLUIDO: ARIA
WEIGHT: 0,9 da N
GEWICHT:
POIDS:
PESO

SERVICE PRESSURE: ①
BETRIEBSDRUCK: MAX. 10 bar
PRESSION DE SERVICE:
PRESSIONE D'ESERCIZIO

* OPENING PRESSURE = MAINTAINED PRESSURE
OEFFNUNGSDRUCK = GESICHERTER DRUCK
PRESSION D'OUVERTURE = PRESSION MAINTENUE
PRESSIONE DI APERTURA = PRESSIONE MANTENUTA

1	7 - 0,3 bar	① ②
2	7 - 0,3 bar	① ②
3	7 - 0,3 bar ①	≥ 4,5 bar ②
4	7 - 0,3 bar ①	≥ 4,5 bar ②
CIRCUIT KREIS CIRCUIT CIRCUITO	OPENING PRESSURE DYNAMIC * OEFFNUNGSDRUCK DYNAMISCH PRESSION D'OUVERTURE DYNAM. PRESSIONE DI APERTURA DINAM.	CLOSING PRESSURE SCHLIESSDRUCK PRESSION DE FERMETURE PRESSIONE DI CHIUSURA
36827 1x D 40.09.87 14.673 C 15.11.76 896 B 9.12.74 821 A 7.5.74 C.N. No. Letter Date	Tolerances not specified Freimaßtoleranzen Tolérances générales Tolleranze generali Scale Maßstab 1:1 Escala Scala	Material Werkstoff Matériau Materiale Surface protection Oberflächenbesch. Protection Protezione Treatment Behandlung Traitement Trattamento
Revisions Änderungen Modifications Modifiche	PROTECTION VALVE (FOR 4 CIRCUITS) SCHUTZVENTIL (FÜR 4-KREIS-ANLAG) VALVE DE PROTECTION (A 4 CIRC.) VALVOLA DI PROTEZIONE (A 4 CIRC.)	Supplied as Lieferzustand État de livraison Stato di consegna Mean value of roughness Ra in µm Mittelrauhwert Ra in µm Valeur de la rugosité Ra en µm Valore della rugosità Ra in µm Blank no. Reihennummer No piece brute No pezzo grezzo
Drawn 2.11.73 50	WESTINGHOUSE JOINT ENGINEERING DEPARTMENT	Replacement for Ersatz für Remplace Sostituisce
Checked		
Approved		