

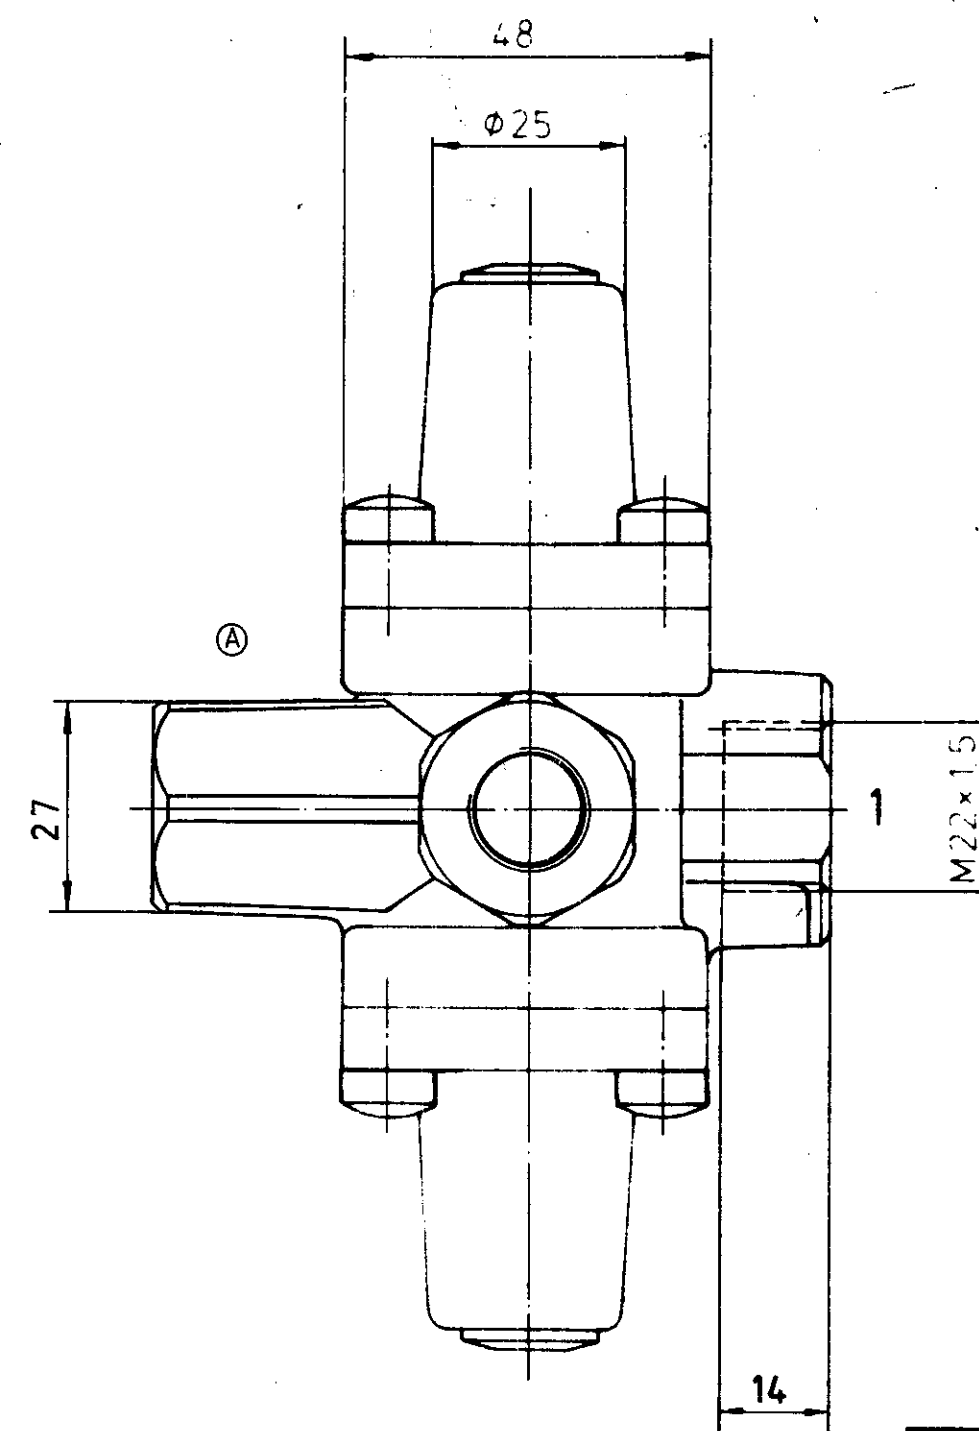
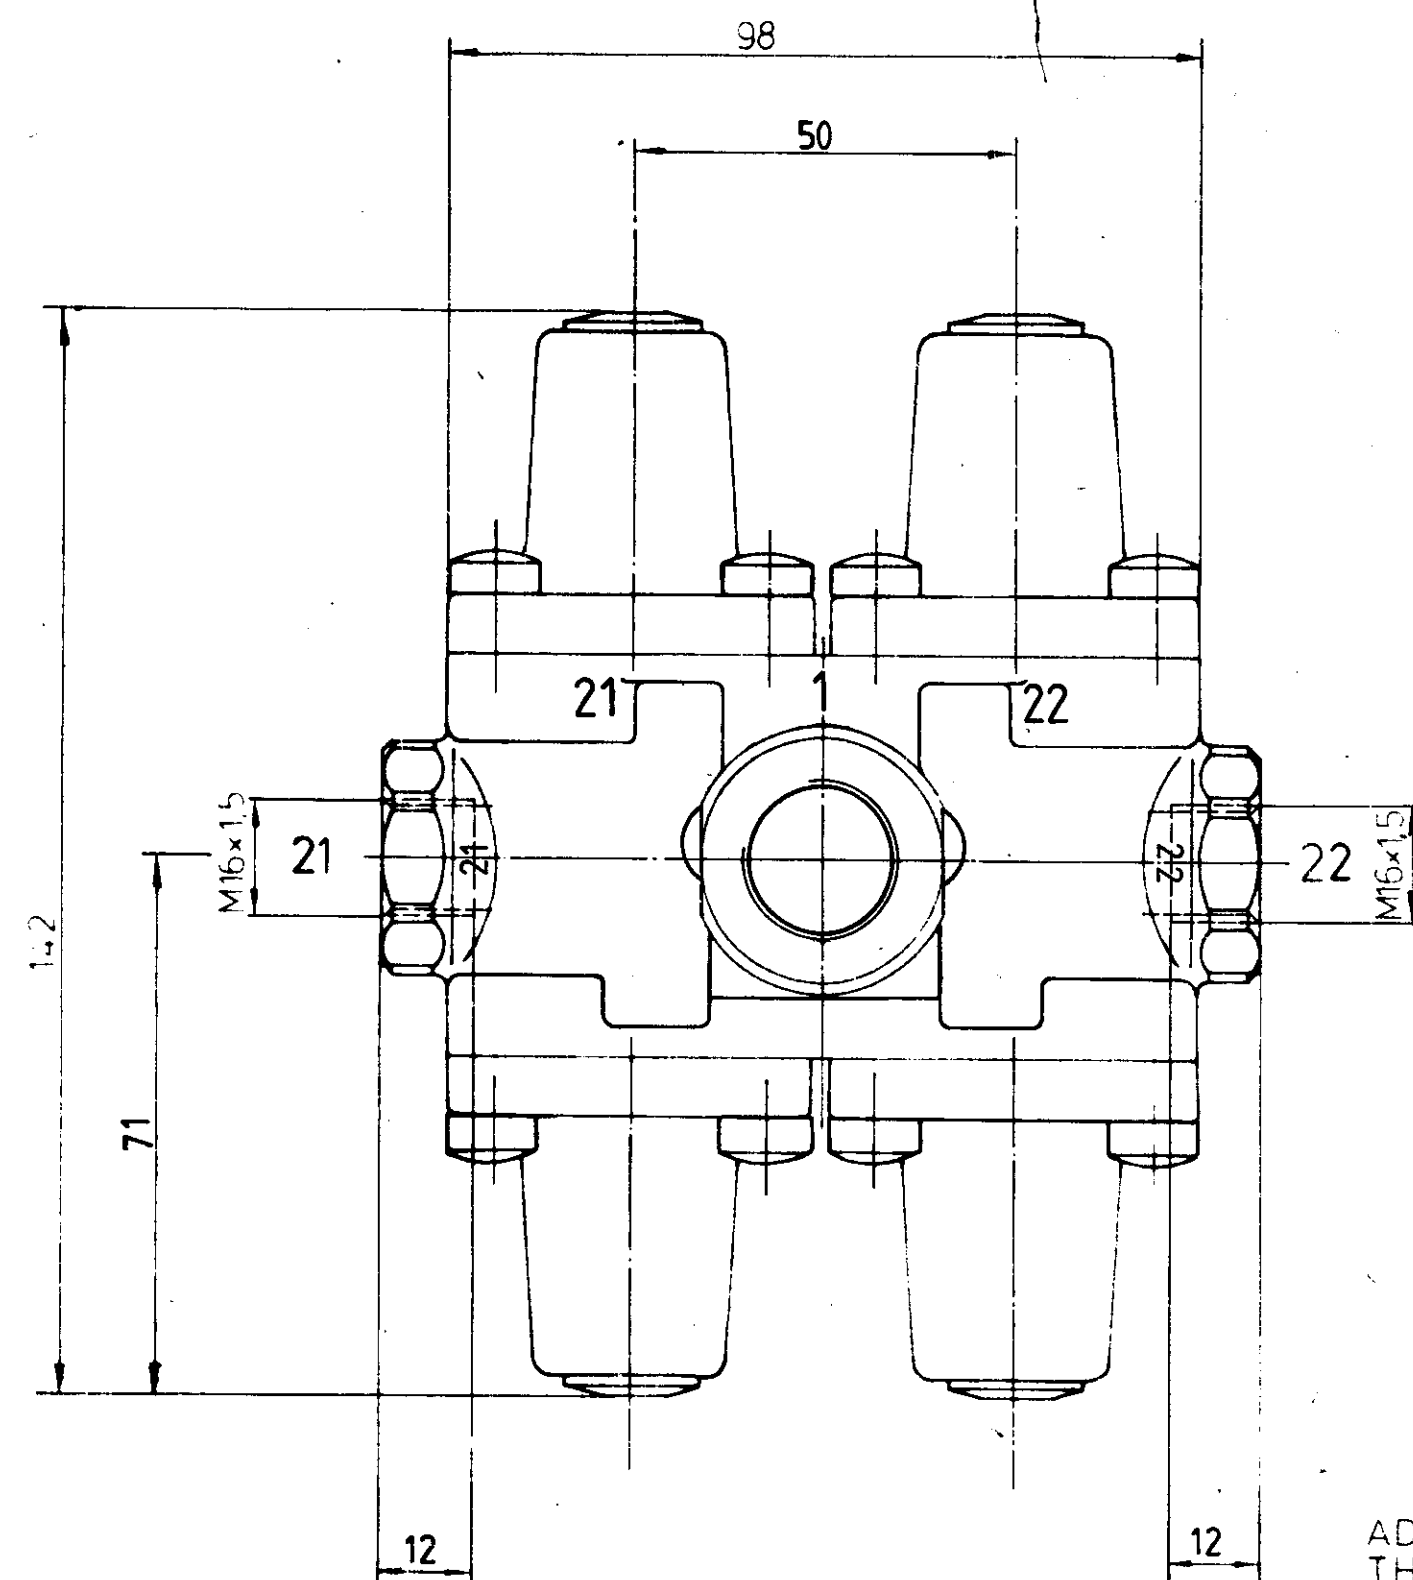


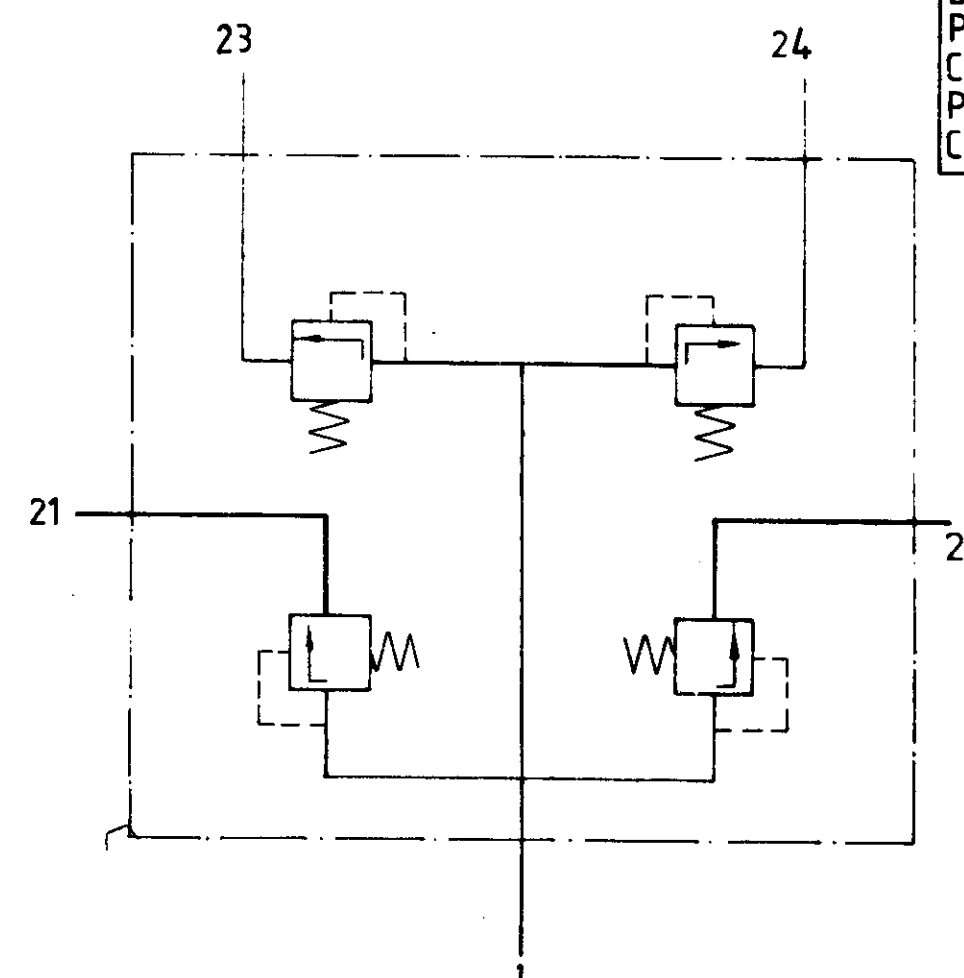

ADMISSIBLE TEMPERATURES
THERMISCHER ANWENDUNGSBEREICH -40°C +90°C
TEMPERATURE DE SERVICE
TEMPERATURA D'ESERCIZIO

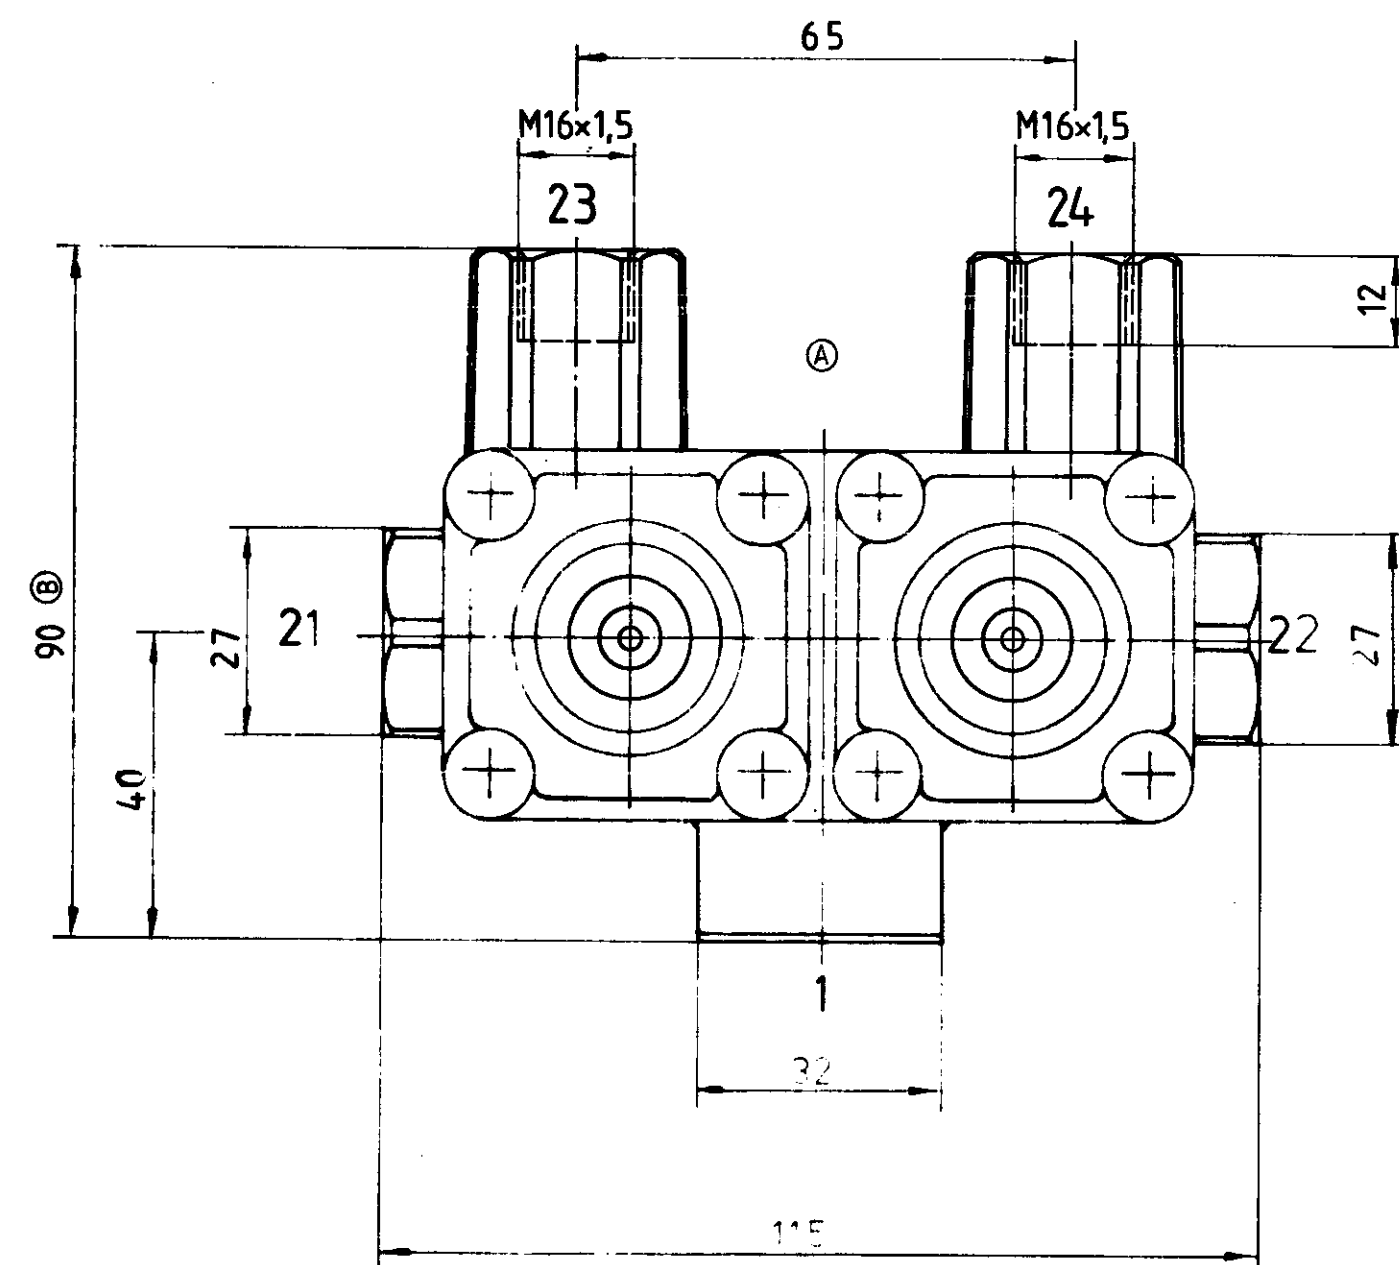

CONNECTIONS:
ANSCHLUESSE
ORIFICES
ORIFIZI

= SUPPLY
= LUFTEINTRITT
= ALIMENTATION
= ALIMENTAZIONE

21 = CIRCUIT 1
= KREIS 1
= CIRCUIT 1
= CIRCUITO 1

22 = CIRCUIT 2
= KREIS 2
= CIRCUIT 2
= CIRCUITO 2

23 = CIRCUIT 3
= KREIS 3
= CIRCUIT 3
= CIRCUITO 3

24 = CIRCUIT 4
= KREIS 4
= CIRCUIT 4
= CIRCUITO 4

MEDIUM AIR
MEDIUM LUFT
MILIEU AIR
FLUIDO ARIA

SERVICE PRESSURE:
BETRIEBSDRUCK:
PRESSION DE SERVICE:
PRESSIONE D'ESERCIZIO:

MAX. 10 bar

CIRCUIT KREIS CIRCUIT CIRCUITO	21	22	23	24
OPENING PRESSURE [bar] OEFFNUNGSDRUCK [bar] PRESSION D'OUVERTURE [bar] PRESSIONE DI APERTURA [bar]	7,0-0,3			
MAINTAINING PRESSURE AT SUPPLY INTO THE INTACT CIRCUITS(DEFECT CIRCUIT 0 bar) SICHERUNGSDRUCK BEI NACHFOERDERUNG IN DEN INTAKTEN KREISEN (DEFEKTER KREIS 0 bar) PRESSION DE MAINTENANCE A ALIMENTATION DU CIRCUIT INTACT (CIRCUIT DEFECT 0 bar) PRESSIONE MANTENUTA AL ALIMENTAZIONE DEL CIRCUITO INTATTO (CIRCUITO DIFETTO 0 bar)	≥ 6,7			

All rights reserved in the event of the grant of a
patent for the registration of a trademark or the use
of the name of the manufacturer or the name of the
product. All rights reserved in the event of the grant of a
patent for the registration of a trademark or the use
of the name of the manufacturer or the name of the
product. All rights reserved in the event of the grant of a
patent for the registration of a trademark or the use
of the name of the manufacturer or the name of the
product.

79-02-20		WESTINGHOUSE	
79-02-20		PROTECTION VALVE (FOR 4 CIRC.) VALVE DE PROTECTION (A 4 CIRC.) VALVOLA DI PROTEZIONE (A 4 CIRC.) SCHUTZVENTIL(FUER 4-KREIS-ANL.)	
3682 24	1	87-09-14	1
1	2	79-06-22	1
2	1	79-05-07	1
A 2		934 702 391 0	
140		505	