

WORKING PRESSURE
BETRIEBSDRUCK
PRESSION D'UTILISATION
PRESSIONE DI ESERCIZIO


p_e max 10bar

MEDIUM: _____ AIR
MEDIUM: _____ LUFT
FLUIDE: _____ AIR
FLUIDO: _____ ARIA

INSTALLATION POSITION AS DRAWN
EINBAULAGE WIE GEZEICHNET
POSITION D'INSTALLATION SUIVANT DESSIN
POSIZIONE DI MONTAGGIO COME D'SEGNAO


1 INLET
EINGANG
ALIMENTATION
ALIMENTAZIONE

2 OUTLET
AUSGANG
SORTIE
USCITA

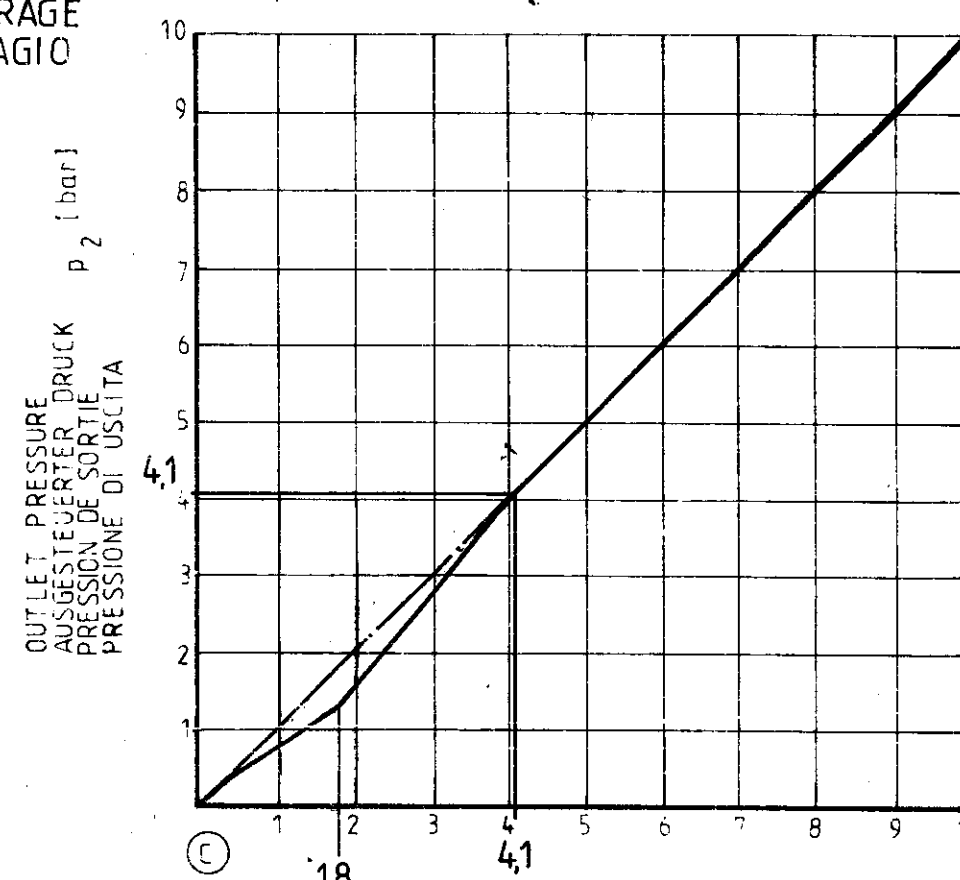

INLET PRESSURE
EINGESTEUERTER DRUCK
PRESSION D'ALIMENTATION
PRESSIONE D'ALIMENTAZIONE

p_1 bar

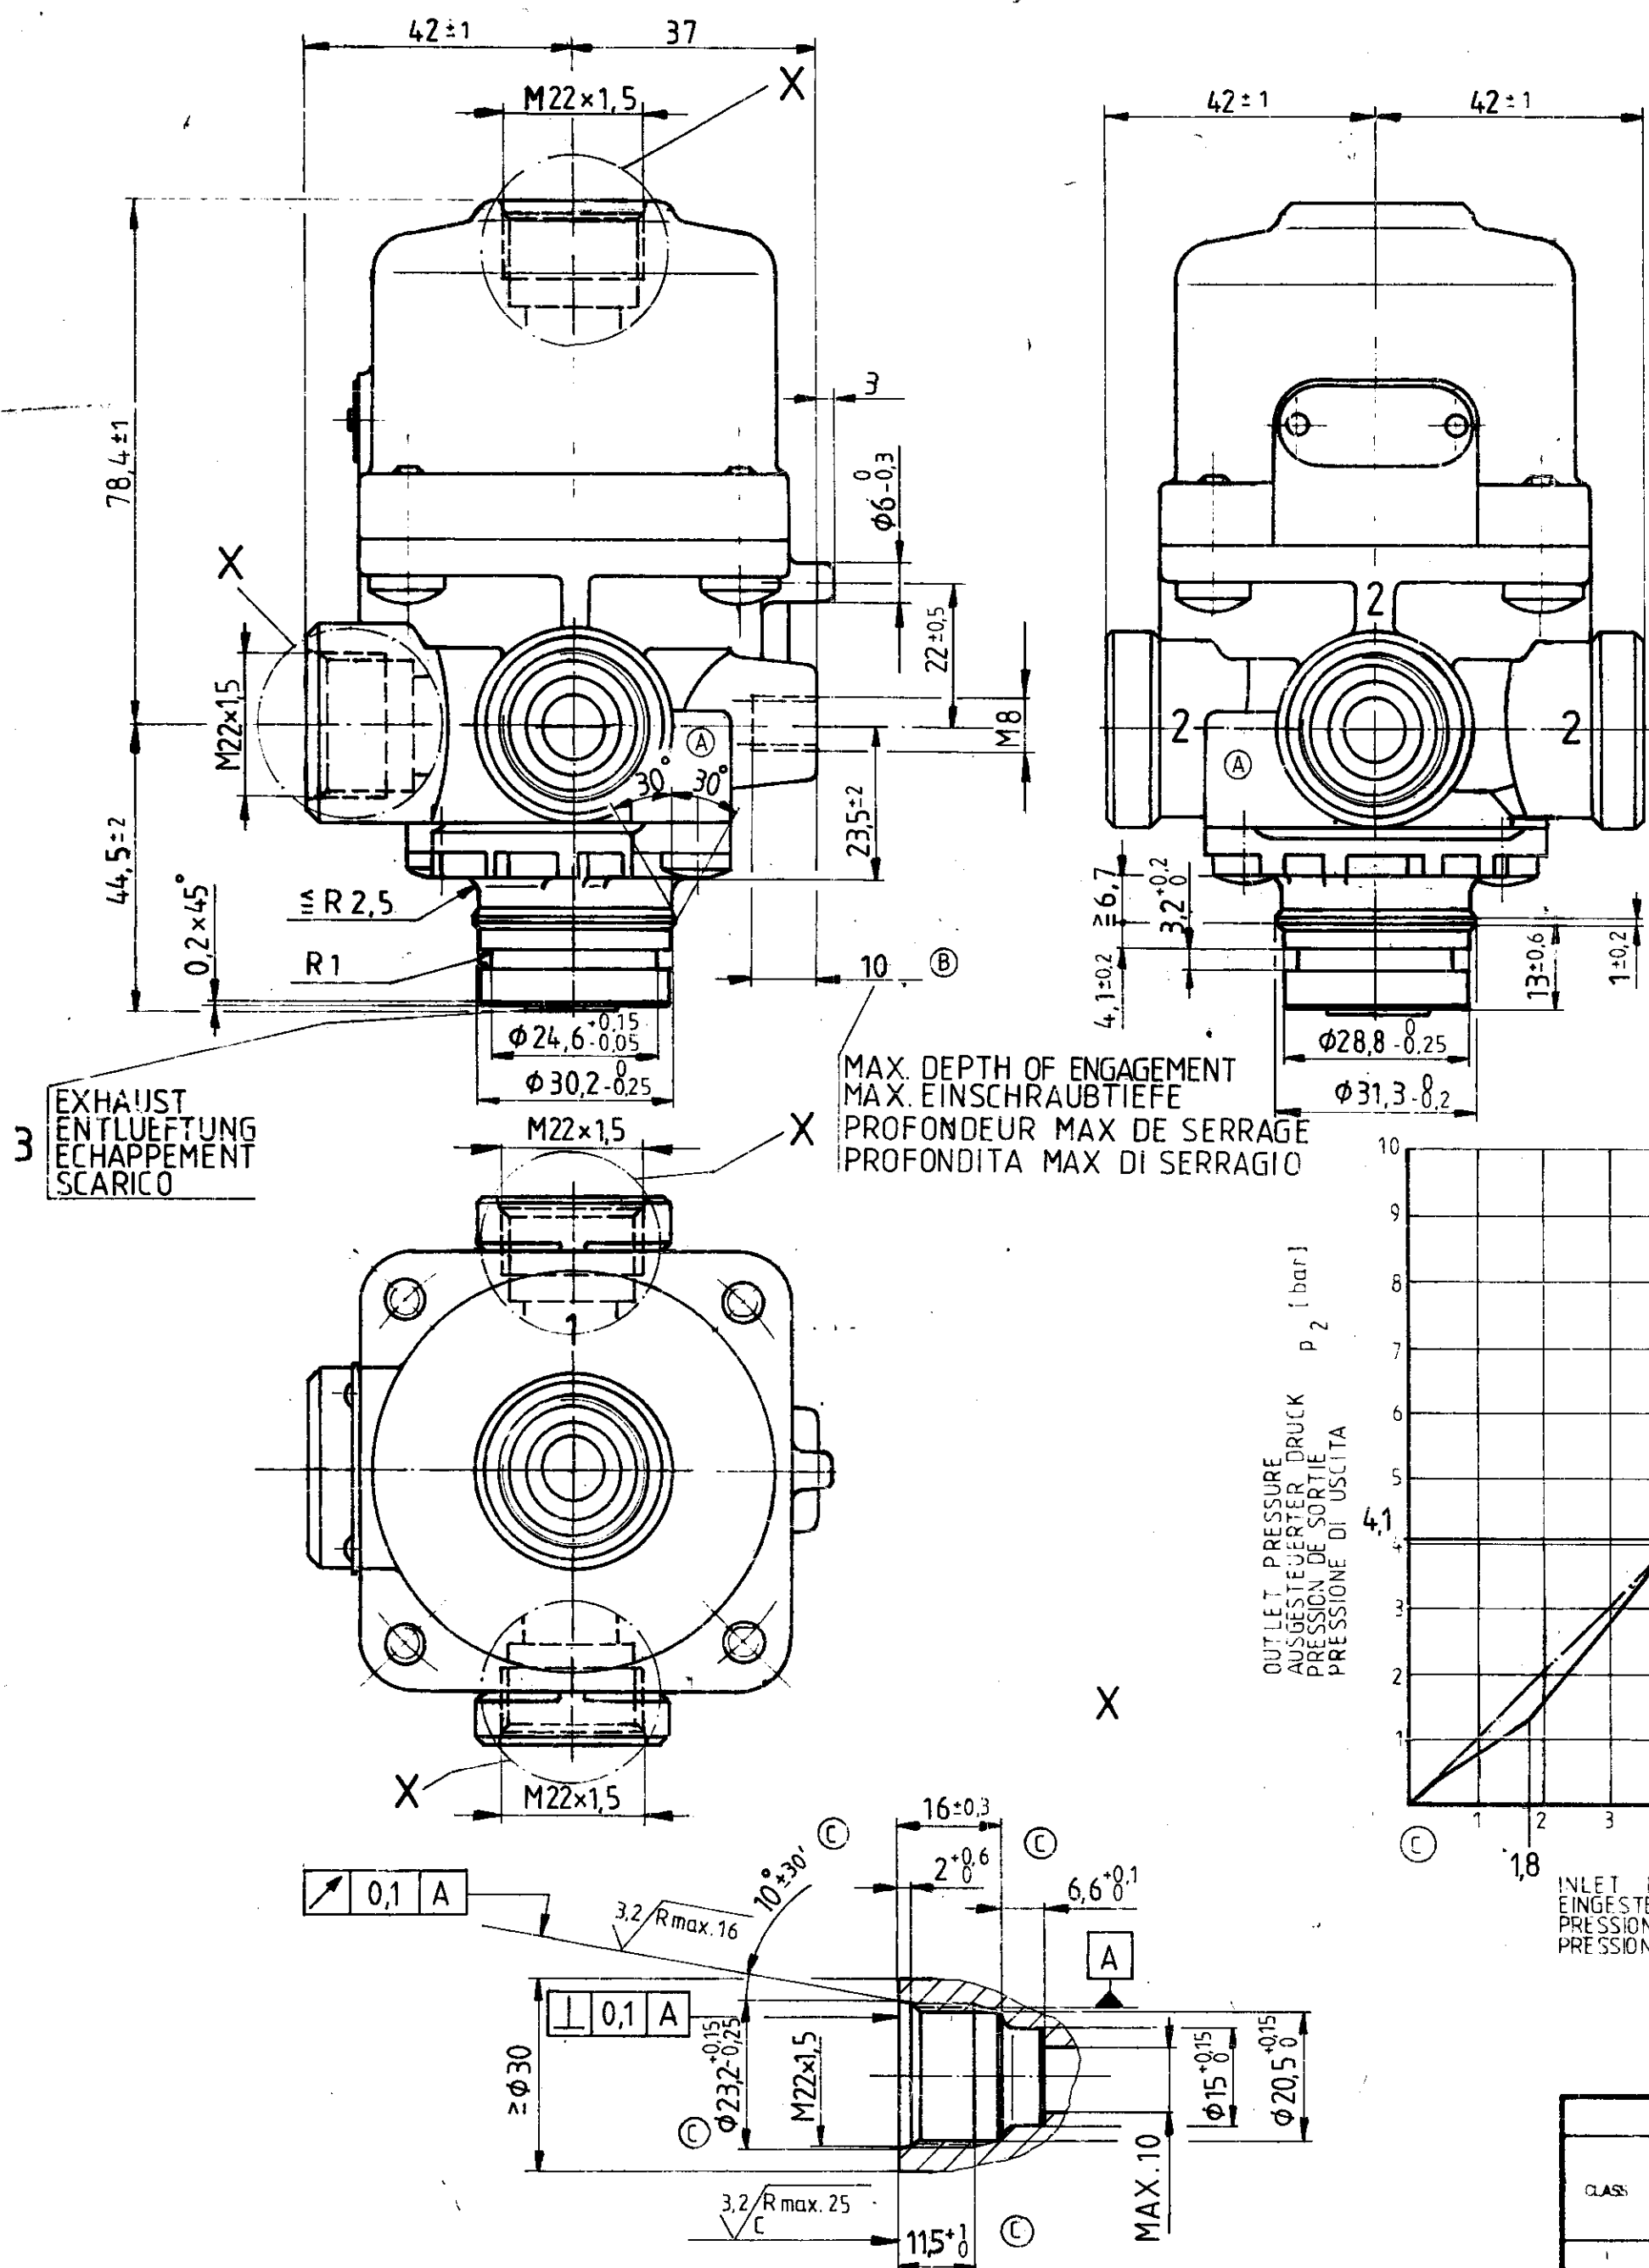

GENERAL TOLERANCES									
CLASS:	RANGE OF NOMINAL DIMENSIONS (+ mm.)							FORCE POWER PRESSURE ETC.	
	to	≤ 50	≤ 180	≤ 400	≤ 600	+		to	+
I		0.5	1	1.5	2			5	
II		2	3	4	5	3		10	
III		2	3.5	5	6.5			20	

TAPPED HOLES ACC

1 TOLERANCE CLASS APPLIED CROSSMARKED

1 2 3 4 5 6 7 8 9 0	COPYRIGHT BY WABCO		WABCO	
	DATE	SIGNATURE		
		DRAWN	ADJUSTING VALVE VALVE D ADAPTION VALVOLA ADATTATRICE ANPASSUNGSVENTIL	
		CHECKED		
		STANDARDIZATION		
3772	5x	88-05-17	86-07-29	<i>P. Brink</i>
36222	1x	87-03-17	86-07-29	<i>John S. Co.</i>
34962	2x	86-11-12	86-08-11	<i>Anten</i>
REPLACEMENT FOR		MASS		SCALE
884 006 643 0		0.6		1:1
OF 86-02-05		SIZE		YRI
		A 2		140
		CODE FOR FUNCTION		CODE FOR SHAPE
		600		605